

ISWS/CIR-144/80

Circular 144

STATE OF ILLINOIS

ILLINOIS INSTITUTE OF NATURAL RESOURCES



*Assessment of Public Groundwater
Supplies in Illinois*

by A. P. Visocky, H. A. Wehrmann, and K. W. Kim

ILLINOIS STATE WATER SURVEY

URBANA

1980

CONTENTS

	Page
Abstract.1
Introduction1
Scope of Study.1
Acknowledgments.2
Public groundwater supplies.2
Aquifers in Illinois.2
Adequacy of public groundwater supplies.4
Criteria for assessment.4
Summary of results.5
Discussion.6
References.10
Appendix11
Addendum74

ASSESSMENT OF PUBLIC GROUNDWATER SUPPLIES IN ILLINOIS

by A. P. Visocky, H. A. Wehrmann, and K. W. Kim

ABSTRACT

Illinois aquifers furnish approximately 233 mgd of water to 677 public groundwater supplies outside the six-county area of northeastern Illinois. Groundwater is usually obtained from sand and gravel deposits in the glacial drift or from limestone or sandstone formations in the underlying bedrock. The most favorable groundwater conditions are found in the northern third and the southern tip of the state; elsewhere, major aquifers are sand and gravel deposits of the Mississippi, Illinois, buried Mahomet, Wabash, Ohio, Kaskaskia, and Embarras valleys.

A brief review was made of data and information in the State Water Survey files for each public groundwater supply, and an assessment was given as adequate, marginal, or deficient, in terms of present demands. The study indicated that 39 supplies were marginal, and four were judged deficient in meeting current demands. The majority of the marginal and deficient supplies are located in the central third of the state, but most of the supplies are located there also.

The study represents the first of a three-part plan to: 1) define problem areas and determine priorities for studies in greater detail, 2) conduct regional studies in problem areas, including test drilling, to determine how great the water resource is (how much can be pumped), and 3) determine the water resource alternatives available to public groundwater supplies that are found to be inadequate.

INTRODUCTION

Scope of Study

Illinois aquifers furnish approximately 233 mgd of water to 677 public water supplies outside the six-county area of northeastern Illinois. Obviously, any planning related to the efficient use of this important resource must be made with information on hand as to quantities pumped, aquifers developed, water resource availability, and anticipated water demand.

This report summarizes available information regarding the current status of public groundwater supplies outside of northeastern Illinois. Each supply has been evaluated for its adequacy to meet present day needs by applying flexible criteria and reported operational experiences.

Twenty-four supplies were known to have recently experienced difficulty in meeting demands, and these were selected for additional detailed study. Each supply was evaluated as to its adequacy for meeting the demand for the year 2000, as estimated by the State Division of Water Resources.

This study represents the first phase of a three-part plan by the State Division of Water Resources to: 1) define problem areas and determine priorities for studies in greater detail, 2) conduct regional studies in problem areas, including test drilling, to determine how great the water resource is (how much can be pumped), and 3) determine the water resource alternatives available to public groundwater supplies that are found to be inadequate.

Acknowledgments

This report was prepared under the general supervision of Dr. William C. Ackermann, now Chief Emeritus of the State Water Survey, and Richard J. Schicht, then Head of the Hydrology Section and now Assistant Chief of the Survey. Mr. Schicht also reviewed the report.

Much appreciation goes to Virginia G. Noel and Pamela S. Lovett for typing the original manuscript, to J. Loreena Ivens and Tony Fitzpatrick for final editing, and to John W. Brother, Jr., and William Motherway, Jr., for their work in preparing the illustrations and the appendix. Alice Wallner prepared the camera copy.

PUBLIC GROUNDWATER SUPPLIES

Aquifers in Illinois

Groundwater in Illinois is usually obtained from sand and gravel deposits, mainly in the glacial drift, or from limestone or sandstone formations in the underlying bedrock. The most favorable groundwater conditions are found in the northern third of the state, where there are dependable sandstone and limestone aquifers in the bedrock and extensive sand and gravel aquifers in the glacial drift. Similar favorable conditions also occur at the southern tip of the state. In the rest of Illinois, the major aquifers are sand and gravel deposits of the Mississippi, Illinois, buried Mahomet, Wabash, Ohio, Kaskaskia, and Embarras valleys (Water for Illinois, a plan for action, 1967).

Areas where conditions are favorable for drilling wells with large yields (500 gpm or more) in sand and gravel are generally associated with the principal sand and gravel aquifers that are within the major valley systems and in the northern third of Illinois. Sand and gravel aquifers of moderate-to-high permeability that are associated with bedrock uplands or minor bedrock valleys usually yield only moderate supplies (100 gpm or more). Sand and gravel wells in areas with similar conditions, but with deposits of only low to moderate permeabilities, have lower yields (20 gpm or more).

In the northern third of the state, large quantities of groundwater for industrial and municipal use are withdrawn from wells in the deep sandstone aquifers of Cambrian and Ordovician age and from the shallow dolomite aquifers of Silurian and Ordovician age (Water for Illinois a plan for action, 1967). In the southern two-thirds of the state, where the glacial drift is thin or relatively impermeable, small water supplies are developed from thin beds of sandstone and limestone of Pennsylvanian and Mississippian age. In the southern tip of Illinois, moderate supplies of groundwater may be withdrawn from wells in creviced limestones of Mississippian, Devonian, and Silurian age.

Several hundred industrial and municipal wells in the northern third of Illinois take large quantities of groundwater from deep sandstone aquifers. Deep sandstone wells often have yields exceeding 700 gpm. Most high-capacity deep sandstone wells in the northern part of the state tap several units and are multi-unit wells. The Galena-Platteville Dolomite, Glenwood-St. Peter Sandstone, and Prairie du Chien Group of Ordovician age and the Eminence-Potosi Dolomite, Franconia Formation, Iron-ton-Galesville Sandstone, and Mt. Simon Sandstone of Cambrian age yield appreciable quantities of water. Water from the deep sandstone is highly mineralized south of the Illinois River. In parts of northern Illinois, yields of deep sandstone wells are increased by penetrating into the Mt. Simon aquifer (lower sandstones of the Eau Claire Formation and upper beds of the Mt. Simon Sandstone). No water wells have penetrated the entire thickness of the Mt. Simon in Illinois, because water below an elevation of about 1300 feet below sea level is commonly too salty for municipal use.

Shallow dolomite aquifers of Silurian age and the Galena-Platteville Dolomite of Ordovician age are the main sources of groundwater for many moderate-to-large public and industrial supplies in the northern third of Illinois. Despite the fact that these shallow dolomite aquifers are inconsistent in productivity and the yields of wells vary greatly from place to place, shallow dolomite wells have been prolific sources of water for over 75 years.

In the southern two-thirds of Illinois, thin sandstone and limestone beds of Pennsylvanian age and sandstone and limestone formations of Mississippian age yield small quantities of groundwater. Although wells in these rocks commonly yield less than 25 gpm, they are the only source of water for many domestic and small municipal and industrial supplies.

In a small area in extreme southern Illinois, wells which penetrate rocks of Mississippian, Devonian, and Silurian age have yields of 100 to 500 gpm or more.

Adequacy of Public Groundwater Supplies

Criteria for Assessment

The investigation of the adequacy of existing public groundwater supplies proceeded as follows.

- 1) A list was prepared of all public groundwater supplies outside of the six-county northeastern Illinois area. Subdivisions with estimated populations of 500 or more were included in the study, but state parks and institutions were not.
- 2) A brief review was made of data and information in the State Water Survey files for each public groundwater supply and an assessment was given as adequate, marginal, or deficient, in terms of present demands. The results of the assessment review are presented in the appendix.
- 3) Supplies with adequate data for analysis and either designated as marginal or deficient or known to have recently experienced water supply problems were studied in greater detail by the State Geological Survey and the State Water Survey. Aquifer safe yields were estimated for each supply.
- 4) The aquifer yields were compared with projected water demands for the year 2000 (provided by the State Division of Water Resources) in order to assess the long-term adequacy of these supplies.
- 5) Recommendations were made by the State Geological Survey for areas in which future groundwater exploration could be undertaken.

The results of the detailed studies (tasks 3-5) are being assessed for presentation in a future report.

The assessment of aquifer adequacy (tasks 1 and 2) for the 677 public groundwater supplies was based on the following criteria.

Adequate Supply - No apparent problems (based on EPA reports) in meeting present demand; usually 10 hours or less pumpage required to produce average daily consumption.

Marginal Supply - Aquifer can supply present demand by operating longer hours: 1) usually 10-18 hours of pumpage required, or 2) several wells with relatively small pumping rates (less than 30 gpm) operate to meet the demand (usually the case where the aquifer is shallow or has low permeability).

Deficient Supply - Aquifer has difficulty supplying present demand:
1) generally 18 hours or more of pumpage is necessary to produce daily consumption, 2) aquifer test data indicate that the aquifer is shallow and of limited areal extent, or 3) need of additional sources of water is indicated by reports of the State Water Survey or the State Environmental Protection Agency.

The criterion of operating time was not a strict one, and the adequate, marginal, or deficient designations overlapped because of other considerations. For instance, one water supply system (Depue-Bureau County) was judged to be adequate, even though 14.7 to 17.5 hours per day were required to meet the average demands. The extenuating factor in this case was that the operating time was caused by limitations in the plant low-service pumps rather than in the wells or aquifer.

Summary of Results

The results of the data review and assessment for the 677 public groundwater supplies studied are tabulated in the appendix.

All facilities with public groundwater supplies or combined surface-groundwater supplies were included except 1) all facilities in the six-county northeastern Illinois area, 2) subdivisions serving less than 500 people, and 3) state parks and state institutions.

Population figures listed in the special census column were from State Environmental Protection Agency Public Water Supply reports, as were the average daily pumpages (although several of the figures for supplies studied in detail were updated by personal telephone communications).

Aquifer descriptions were based on well logs or reports by the State Geological Survey on the groundwater geology of each well field.

Aquifer tests conducted and analyzed by the State Water Survey were labeled SWS.

The results of the study indicated that the 677 public groundwater supplies outside northeastern Illinois have an estimated daily pumpage of 233 million gallons. Among individual counties, Winnebago County topped the list with a pumpage of 43.1 mgd. Other large public groundwater-consuming counties are Peoria (20.7 mgd), Champaign (18.2 mgd), Tazewell (12.3 mgd), and LaSalle (10.1 mgd). The largest individual supply is the city of Rockford, which pumps an average of 37.0 mgd. Seven counties (all in the southern third of the state) have no public groundwater supplies: Clay, Franklin, Hamilton, Jefferson, Johnson, Pope, and Williamson. Champaign, LaSalle, Bureau, and Madison Counties have 20 or more supplies each. The largest supplies were generally obtained from major alluvial or bedrock valley deposits.

As summarized in table 1, 39 supplies were assessed as marginal and 4 were judged deficient in meeting current demands. Pumpage from these supplies totaled 5.54 mgd, or 2 percent of the total pumpage from the 677 supplies that were assessed. The four supplies assessed as being deficient were all either from shallow bedrock (limestone or thin sandstone) aquifers or from a combined shallow-bedrock/sand-and-gravel aquifer system. Nine of the marginal supplies were from shallow bedrock aquifers and 28 were from limited sand-and-gravel aquifers such as narrow bedrock-valley deposits. One marginal supply was obtained from two sources: a shallow sand-and-gravel deposit and limestone and sandstone units of the Ordovician System. One supply was assessed as marginal because of inadequate facilities, even though the sand-and-gravel aquifer is capable of meeting the water demand of that community. The majority of the marginal and deficient supplies are located in the central third of the state; however, so are most of the supplies. Thirty counties were found to have one or more supplies that are less than adequate. Adams, Champaign, Henry, Madison, and Pike Counties all have three such supplies, while counties with two less-than-adequate supplies include Effingham, Montgomery, and Vermilion. Figure 1 indicates the number of public groundwater supplies in each county as well as the number of marginal and deficient supplies; figure 2 shows locations of the marginal and deficient supplies.

Discussion

The study proved useful in indicating the generally adequate nature of most groundwater supplies throughout the state. Of greater importance, however, were the data obtained concerning areas of the state in which future groundwater supply shortages might appear. With such problem areas in view, the state can assist those communities in planning for adequate water supplies. Phase 2 of the overall plan calls for test drilling at sites recommended by the State Geological Survey to define aquifer limits and/or locate new aquifers. After test drilling is completed, the magnitude of the available resource (how much water can safely be withdrawn) will be estimated. For communities whose water supplies are still deemed inadequate in meeting projected needs, other alternatives will be investigated.

Illinois aquifers have in the past furnished abundant water supplies to municipalities and industries and continue to do so in most localities today. Communities that have experienced shortages (or that might at some future date) can now, with the information gathered in these studies, look forward with less uncertainty to meeting their anticipated water needs.

Table 1. Groundwater Supplies Assessed as Less Than Adequate

<u>County</u>	<u>Supply</u>	<u>Assessment</u>
Adams	Camp Point	D
	Golden	M
	Lorraine	M
Brown	Versailles	M
Bureau	Princeton	M
Champaign	Broadlands	M
	Homer	M
	Philo	M
Christian	Edinburg	M
Clinton	Germantown	M
Coles	Lerna	D
Cumberland	Toledo	M
Douglas	Hindsboro	M
Effingham	Dieterich	M
	Watson	M
Fulton	Dunfermline - St. David	M
	Water Commission	
Henry	Bishop Hill	M
	Colona	M
	Osco	M
Lawrence	Birds - Pinkstaff Public	M
	Water District	
Macon	Oreana	M
Madison	Hamel	M
	Marine	M
	Worden	M
McDonough	Colchester	M
McLean	Chenoa	M
Menard	Tallula	M
Montgomery	Farmersville	M
	Fillmore	M
Moultrie	Gays	M
Pike	Baylis	D
	Nebo	M
	Pearl	M
Randolph	Red Bud	M
Richland	Noble	M
Rock Island	Coal Valley	D
Sangamon	DeKalb Agricultural Research, Incorporated	M
Scott	Winchester	M
Shelby	Windsor	M
St. Clair	Millstadt	M
Vermilion	Indianola	M
	Oakwood	M
Warren	Roseville	M

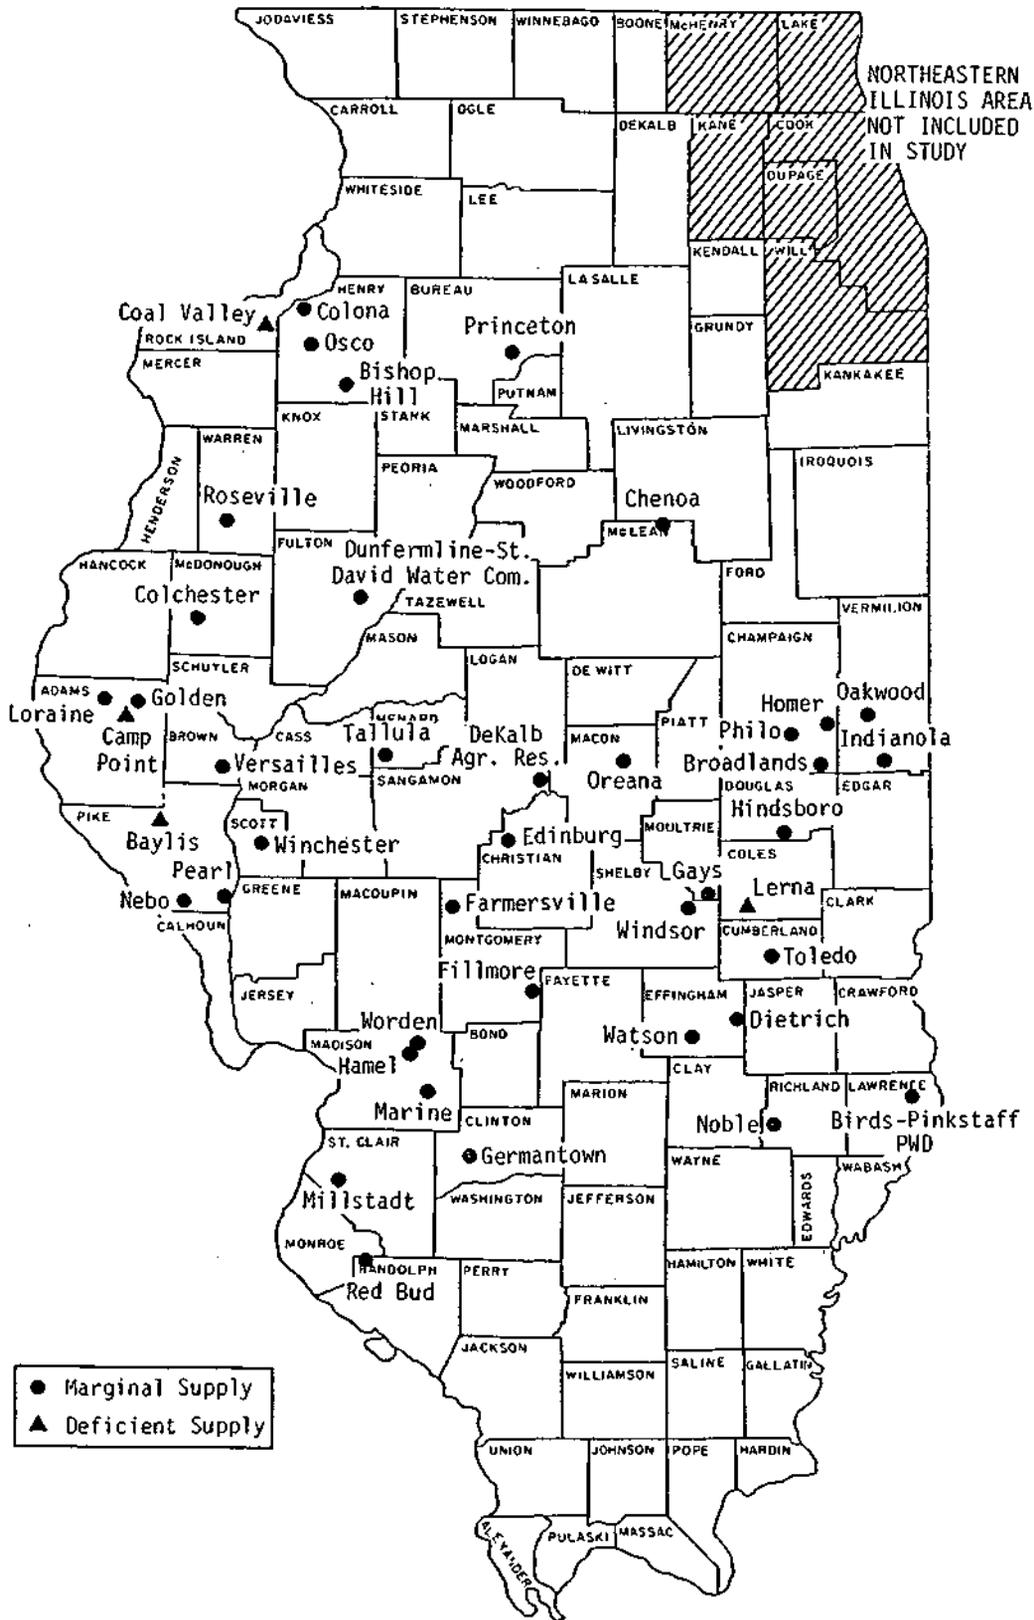


Figure 2. Locations of marginal and deficient groundwater supplies

REFERENCES

- Visocky, A. P., H. A. Wehrmann, K. W. Kim, and R. W. Ringler. 1978. *Assessment of public groundwater supplies in Illinois*. Illinois State Water Survey and State Geological Survey Cooperative Contract Report, Urbana.
- Water for Illinois, a plan for action*. 1967. Illinois Department of Business and Economic Development, Springfield.

APPENDIX

PUBLIC GROUNDWATER SUPPLY ASSESSMENT

1. Adams County

Facility	Population 19 70 census	spec. census	Average daily pumpage (gallons) (yr)	Aquifer description	Well no.	Depth (ft)	Discharge (gp ^m)	Aquifer test	Aquifer assessment																																																																																																																																																												
Adams Co. Water District: #1		60S (Est. 1975)	28,000 1975	Mississippian Syst. (Keokuk-Burlington Limestone)	1	90	40	6/1/72 SWS	Adequate. The supply serves four villages, Fouler, Paloma, Coats- burg, and Columbus.																																																																																																																																																												
					2	80	18			Car.p Point	1,143		76,000 1975	Pleistocene Series (sand and gravel)	3	24	16	7/29/70	Deficient. As of 1975, all pumps operating 24 hrs/day.	4	40	7	7/29/70	Mississippian Syst. (Keokuk-Burlington Limestone)	5	56	3	7/29/70	6	415	3	0/18/70	7	1036	1	3/11/76 SWS	8	410	3	8/18/70	9	385	3	8/18/70	10	415	4	8/18/70	11	420	2	8/18/70	12		8		Colden	571		30,000 1976	Pennsylvanian Syst. (sandstone)	1	80	Standby	6/28/49	Marginal	2	83	6.5	Mississippian Syst. (Keokuk-Burlington Limestone)	6	75	9.5	7	380	7.5	Liberty	369		26,600 1976	Mississippian Syst. (St. Louis-Fern Glen Uhnestone)	8	420	11.5	5/19/70	2	295	8	11/5/63 SWS	Adequate	3	308	18	10/17/68	4	355	8	2/2/72 SWS	5	284	9	7/18/73 SWS	6	340	10-20	11/11/75 SWS	Lorraine	372		20,000 1976	Mississippian Syst. (Keokuk-Burlington Limestone)	1	300	12	5/15/56	Marginal	2	300	10-15	5/15/72	3	340	15'	5/23/56 SWS 2/15/72 SWS 9/5/74 SWS	Mendon	883		71,000 1976	Mississippian Syst. (Warsaw limestone)	8	176	100	10/9/62 SWS	Adequate	9	180	90		Mill Creek Water District		2135 (Est. 1978)	140,000 1978	Mississippi River Valley alluvium	1	80	275	8/24/72 SWS	Adequate	Payson	539		70,000 1375	Mississippian System (Burlington Limestone)	1	330	75	8/7/40 SWS	Adequate	2	304	100	9/14/67 SWS			
Car.p Point	1,143		76,000 1975	Pleistocene Series (sand and gravel)	3	24	16	7/29/70	Deficient. As of 1975, all pumps operating 24 hrs/day.																																																																																																																																																												
					4	40	7	7/29/70						Mississippian Syst. (Keokuk-Burlington Limestone)	5	56	3	7/29/70		6	415	3	0/18/70		7	1036	1	3/11/76 SWS	8	410	3	8/18/70	9	385	3	8/18/70	10	415	4	8/18/70	11	420	2	8/18/70	12		8		Colden	571		30,000 1976	Pennsylvanian Syst. (sandstone)	1	80	Standby					6/28/49	Marginal	2	83			6.5	Mississippian Syst. (Keokuk-Burlington Limestone)	6	75	9.5	7	380	7.5	Liberty	369							26,600 1976	Mississippian Syst. (St. Louis-Fern Glen Uhnestone)	8	420	11.5	5/19/70	2		295	8	11/5/63 SWS	Adequate	3	308	18	10/17/68	4	355	8	2/2/72 SWS	5	284	9	7/18/73 SWS						6	340	10-20	11/11/75 SWS		Lorraine	372		20,000 1976	Mississippian Syst. (Keokuk-Burlington Limestone)	1	300	12	5/15/56	Marginal	2	300	10-15	5/15/72	3	340	15'	5/23/56 SWS 2/15/72 SWS 9/5/74 SWS	Mendon	883		71,000 1976	Mississippian Syst. (Warsaw limestone)	8	176	100	10/9/62 SWS	Adequate	9	180	90		Mill Creek Water District		2135 (Est. 1978)	140,000 1978	Mississippi River Valley alluvium	1	80	275	8/24/72 SWS	Adequate	Payson	539		70,000 1375	Mississippian System (Burlington Limestone)	1	330
				Mississippian Syst. (Keokuk-Burlington Limestone)	5	56	3	7/29/70																																																																																																																																																													
					6	415	3	0/18/70																																																																																																																																																													
					7	1036	1	3/11/76 SWS																																																																																																																																																													
					8	410	3	8/18/70																																																																																																																																																													
					9	385	3	8/18/70																																																																																																																																																													
					10	415	4	8/18/70																																																																																																																																																													
					11	420	2	8/18/70																																																																																																																																																													
					12		8																																																																																																																																																														
					Colden	571		30,000 1976							Pennsylvanian Syst. (sandstone)	1	80	Standby		6/28/49	Marginal																																																																																																																																																
										2	83	6.5																																																																																																																																																									
Mississippian Syst. (Keokuk-Burlington Limestone)	6	75	9.5																																																																																																																																																																		
	7	380	7.5																																																																																																																																																																		
Liberty	369		26,600 1976	Mississippian Syst. (St. Louis-Fern Glen Uhnestone)	8	420	11.5	5/19/70																																																																																																																																																													
					2	295	8	11/5/63 SWS	Adequate																																																																																																																																																												
					3	308	18	10/17/68																																																																																																																																																													
					4	355	8	2/2/72 SWS																																																																																																																																																													
					5	284	9	7/18/73 SWS																																																																																																																																																													
					6	340	10-20	11/11/75 SWS																																																																																																																																																													
Lorraine	372		20,000 1976	Mississippian Syst. (Keokuk-Burlington Limestone)	1	300	12	5/15/56		Marginal																																																																																																																																																											
					2	300	10-15	5/15/72																																																																																																																																																													
					3	340	15'	5/23/56 SWS 2/15/72 SWS 9/5/74 SWS																																																																																																																																																													
Mendon	883		71,000 1976	Mississippian Syst. (Warsaw limestone)	8	176	100	10/9/62 SWS	Adequate																																																																																																																																																												
					9	180	90																																																																																																																																																														
Mill Creek Water District		2135 (Est. 1978)	140,000 1978	Mississippi River Valley alluvium	1	80	275	8/24/72 SWS	Adequate																																																																																																																																																												
Payson	539		70,000 1375	Mississippian System (Burlington Limestone)	1	330	75	8/7/40 SWS	Adequate																																																																																																																																																												
					2	304	100	9/14/67 SWS																																																																																																																																																													

Plainville	289	26,000	1976	Mississippian System (limestone)	1	141	25	8/10/62	SWS	Adequate
					2	188	9	9/12/62	SWS	
					3	230	5	11/12/76	SWS	
					4	220	15	9/29/77	SWS	
					5	167	40	10/12/77	SWS	
Ursa	423	26,000	1976	Mississippian System (limestone)	1	200	80	6/21/66	SWS	Adequate
2. Alexander County										
Central Alexander County Public Water District	unknown	unknown		Sand and gravel	1	98	500	2/16/72	SWS	Insufficient data for aquifer assessment .
McClure East Cape Cirardcau Public Water District	752 (Est.)	50,000	1974	Sand and gravel	1	108	125	10/9/67	SWS	Adequate
Tamms	645	27,000	1974	Sand and gravel	1	171	100	5/19/71	SWS	Adequate
Thebes	442	25,000	1974	Ordovician System (Kimmswick gray lime)	1	300	80	9/9/64	SWS	Adequate
3. Bond County										
Greenville	4,631	522,900	1975	Pleistocene Series (sand and gravel) Pennsylvanian System (limestone)	2	70	250	3/4/59	SWS	Adequate. Surface water is the main source for public water supply. Ground water is used for emergency.
					5	74	250			
Mulberry Grove	697	49,600	1975	Sand and gravel	1	40	36	4/7/41	SWS	Adequate. Treated water is obtained from Greenville
					3	37	30	12/31/62	SWS	
					4	33	20			
Pocahontas	764	50,000	1976	Sand and gravel	1	46.8	25	5/4/54	SWS	Adequate
					2	36	25	8/22/72	SWS	
					4	31	25	9/19/67	SWS	
					5	35	20	5/19/72	SWS	
Smithboro	203									Adequate. Treated water is obtained from Greenville

4. Boone County

Facility	1970 census	spec. census	(gallons) (yr)	Aquifer description	Well no.	Depth (ft)	Discharge (gpm)	Aquifer test	Aquifer assessment
Belvidere	14,061		3,600,000 1977	Pleistocene Series	2	1861	500		Adequate
				(burled Troy Bedrock	3	1803	500		
				Valley, sand and	4	1800	1000	9/14-15/42 SWS	
				gravel)	5	610	600	10/15-16/45 SWS	
				Ordevician System	6	868	1000	6/15/55 SWS	
				(St. Peter Sandstone)	7	969	1000	11/15-16/62 SWS	
				Cambrian System	8	1393	1500	7/20-21/64 SWS	
				(Ironton-Calesville	9	122	1250	6/5/69 SWS	
				Sandstone, Mt. Simon Sandstone)					

Capron	654		65,000 1976	Ordovician System (Maquoketa limestone, St. Peter sandstone)	1	880	150	11/29/77	Adequate
--------	-----	--	-------------	--	---	-----	-----	----------	----------

Poplar Grove	607		45,000 1976	Sand and gravel	2	184	185		Adequate
--------------	-----	--	-------------	-----------------	---	-----	-----	--	----------

5. Brown County

Mound Station	203		12,000 1976	Mississippian System (Keokuk-Burlington Limestone)	1	483	30	12/29/64 SWS	Adequate
---------------	-----	--	-------------	--	---	-----	----	--------------	----------

Versailles	429		38,000 1976	Sand and gravel	1	45	24	7/13-14/53 SWS	Marginal
					2	36	24	7/13-14/53 SWS	

6. Bureau County

Arlington	250		25,300 1976	Sand and gravel	2	94	18		Adequate
					3	100	20	1/20/55 SWS	

Buda	675		96,000 1976	Ordovician System	2	1630	200		Adequate
				(Calena-Platteville	4	135	100		
				Dolomite, St. Peter Sandstone) Silurian System (Niagaran- Alexandrian dolomite)	5	1601	175	3/18/68 SWS	

Bureau Junction	466		21,300 1976	Silurian System (Niagaran dolomite)	2	305	flowing		Adequate
					4	334	flowing		

Cherry	551		35,000 1976	Sand and gravel	1	33	60	11/22/40 SWS	Adequate
					2	34	100		

Dalzell	579		35,000 1976	Sand and gravel	2	155	70	2/2-5/62 SWS	Adequate
					3	81.5	75		

DePue	1,919	176,300	1976	Silurian System	2	1487	120		Adequate	
				(Niagaran-Alexandrian dolomite)	3	1490	250			
				Ordovician System (Galena-Platteville Dolomite, St. Peter Sandstone)						
Dover	176	8,100	1976	Sand and gravel	1	294	110		Adequate	
Ladd	1,328	175,000	1977	Ordovician System	1	1860	300	1/9/40 SWS	Adequate	
				(Galena-Platteville limestone, St. Peter Sandstone) Pleistocene (sand and gravel)	2	163	450	12/22-23/48		
LaMoille	669	61,000	1976	Sand and gravel	2	331	180	8/8/36	Adequate	
					3	341	240			
Maiden	262	17,000	1976	Sand and gravel	1	270	140	9/9-10/70 SWS	Adequate	
Manlius	402	53,000	1977	Sand and gravel	2	268	100	11/7/67 SWS	Adequate	
					3	285	120			
Mineral	286	25,000	1976	Silurian System	1	375	30	8/12/54	Adequate	
				(limestone and dolomite)	2	447	30	5/21/64 SWS		
Neponset	507	29,000	1976	Pennsylvanian System	2	250	Standby	3/14/55 SWS	Adequate	
				(shale, limestone, sandstone)	3	1640	163			2/29/56
				Ordovician System	4	200	Standby			
				(Galena-Platteville dolomite)						
Ohio	506	44,000	1976	Sand and gravel	2	385	65	6/29/67 SWS	Adequate	
					4	404	200			
					5	434	250			
Princeton	6,959	1,286,000	1977	Sand and gravel	3	260	1000		Marginal	
					5	270	800			
Sheffield	1,038	93,000	1976	Sand and gravel	4	71	200	10/23/61 SWS	Adequate	
					5	73	170	9/26/69 SWS		
Spring Valley	5,605	1,102,000	1977	Pleistocene Series	8	46	Standby		Adequate	
				(sand and gravel)	9	50	Standby			
				Ordovician-Cambrian	10	2696	1300			6/8-14/67 SWS
				Systems (sandstone)	11	2723	1500			11/4/76
Tiskilwa	973	103,000	1977	Sand and gravel	1	92	100		Adequate	
					2	140	150			

Facility	Population 1970 census	spec. census	Average daily pumpage (Callous) (yr)	Aquifer description	Well no.	Depth (ft)	Discharge (gpm)	Aquifer test	Aquifer assessment
Van Orin	100 (Est. 1976)		5,000 1976	Sand and gravel	1	258	40		Adequate
Walnut	1,295		201,000 1977	Sand and gravel	4	247	190		Adequate
					5	272	190		
					6	267	350		
Wyaner	1,005		97,500 1976	Sand and gravel	1	218	130		Adequate
					2	225	130		
7. Calhoun County									
Batchtown	217		13,500 1976	Mississippi River Valley alluvium	.1 2	86.5 86	30 28	4/4/66 SWS	Adequate
Brussels	191		35,000 1976	Alluvial sand and gravel	1	78	105	12/10/63 SWS	Adequate
Hardin	1,035		215,000 1975	Sand and gravel	1 2	70 64	250 100	4/21/72 SW 1/13/54 SWS	Adequate
Kampsville	439		38,000 1975	Alluvial sand and gravel	1 2	60 52	80 71	7/11/56 SWS	Adequate
8. Carroll County									
Chadwick	605		54,100 1977	Cambrian-Ordovician Systems (Galena-Platte- ville Dolomite, St. Peter Sandstone, Gales- ville Sandstone)	2 3	1215 1210	Standby 400	8/24/67 SWS	Adequate
Lanark	1,495		227,000 1977	Cambrian-Ordovician Systems (St. Peter Sandstone, Ironton Sandstone)	3 4	1100 1082	400 250	2/20/57 SWS 7/13/71	Adequate
Milledgeville	1,130		117,000 1977	Cambrian-Ordovician Systems (Shakopee, Oneota limestone, Cales- ville Sandstone)	3 4	675 1146	Standby 350		Adequate
Mt. Carroll	2,143	215,000	1977	Ordovician System (St. Peter Sandstone) Cambrian System (Eau Claire sandstone)	2 3	1457 1453	700 400	12/20/55 SWS	Adequate

Savarna	4,942	782,000	1977	Ordovician System	3	1780	Standby	9/15/27	SWS	Adequate
				(Galena-Platteville	4	1308	550			
				Dolomite, Glenwood	5	1804	585	12/10/52	SWS	
				Sandstone) Cambrian	6	1300	1200	3/15/65		
Shannon	848	115,000	1977	Ordovician System	1	250	100	3/13/57	SWS	Adequate
				(Calena-Platteville	2	698	185			
Thomson	617	58,000	1977	Sand and gravel	2	60	70			Adequate
					3	81	185	9/13/54	SWS	
					4	65	400	9/5/75		
9. Cass County										
Arenzville	403	30,000	1976	Sand and gravel	1	60	100	3/20/47		Adequate. Alternates in use with WW1 on daily basis.
					2	60	100	6/13/69	SWS	
Ashland	1,128	85,000	1975	Indian Creek bottom-	1	21	42	10/17/35		Adequate. Main public water supply is from Little Indian Creek surface water. All w a t e r (WW1, WW2, WW3, WW4) is maintained for emergency use during extended drought period.
				land sand and gravel	2	21	42			
					3	21	42			
					4	27	150	g r o u n d		
Beardstown	6,222	1,100,000	1977	Illinois River Valley	5	78	Standby	11/17/70	SWS	Adequate
				alluvium	7	86	"	6/30/75		
					8	89	"	7/9/75		
					11	92	"	7/24/75		
					12	92				
					13	86	600			
					14	83	700			
					15	80	700			
					16	81	700			
Chandlerville	762	75,000	1977	Sangamon River Valley	1	34	Standby	7/9-10/36	SWS	Adequate
				alluvium	2	37	150	5/13/69	SWS	
Virginia	1,814	155,000	1976	Sangamon River Valley	1	29	40	12/10/76	SWS	Adequate. Public water supply is obtained from impoundment reservoir. Groundwater is maintained only for emergency source during extended drought.
				alluvium	2	30	40			

10. Champaign County

Facility	Population		Average daily pumpage (gallons) (yr)	Aquifer description	Well no.	Depth (ft)	Discharge (gpm)	Aquifer test	Aquifer assessment	
	197C census	spec. census								
Broadlands	315		21,000 1977	Sand and gravel	1 2	71.5 78	35 10	3/14/55 SWS 10/3/77 SWS	Marginal. Limited aquifer.	
Champaign- Urbana	56,837 33,976	59,152 (1972) 34,502 (1972)	15,000,000 1978	Mahomet Bedrock Valley, sand and gravel, Illinoian glacial drift	35 40 41 42 43 45 46 47 48 53 54 55 56 57 58 59 60 61	208 212 224 217.5 224.5 197 207.2 217.2 232 289 330.5 300 318 297 326.5 338.4 340 296.5	500 275 600 700 700 375 350 385 700 2100 3000 1000 2100 2100 2800 2100 2400 2100	4/10/78 10/20/44 5/12/47 12/26/56 11/26,28,29/56 4/7-9/71 7/9,10,11/74	Adequate. Wells are located in two well fields: 1) West field (West of Mattis Ave. in Champaign); Well #48,53,54,55,56,57,58,59,60,61. 2) North Well field (Corner of N. Goodwin & Bradley Ave. in Urbana); Well # 35,40,41,42, 43,45,46,47.	
Dewey Public Water District		220 (Est. 1976)	9,000 1976	Mahomet Bedrock Valley sand and gravel	1	273	48	6/17/69 SWS	Adequate	
Fisher	1,525		100,000 1976	Mahomet Bedrock Valley sand and gravel	1 3	236 270	125 200		Adequate	
Cifford	814		56,000 1973	Mahomet Bedrock Valley sand and gravel	1 2	157 165	127 100	9/5/61 SWS 3/1/66 SWS	Adequate	
Homer	1,354		100,000 1978	Sand and gravel	1 2 3	72 60.5 59	30 100 100	5/4/66 SWS 6/8/52 SWS 11/24/59 SWS 1/9/65	Marginal	
Ivesdale	357		24,700 1975	Sand and gravel	1	85	50	9/24/65 SWS	Adequate	
Longview	275		21,000 1978	Sand and gravel	1	50	60	5/20/55 SWS	Adequate	
Ludlow	531		50,000 1976	Mahomet Bedrock Valley sand and gravel	1 2	122 122.5	90 110	10/15/48 SWS	Adequate	
Mahomet	1,296	1,520 (1974)	170,000 1973	Mahomet Bedrock Valley sand and gravel	2 3	97 251.6	90 190		Adequate	

Ogden	703		61,000	1977	Sand and gravel	1	65	150	9/23/52	SWS	Adequate
						2	70	108			
Penfield Water District	Public 240 (Est. 1973)		15,000	1976	Sand and gravel	1	195	50	2/10/66	SWS	Adequate
						2	200	50	10/13/77	SWS	
Pesotun	536		45,000	1976	Sand and gravel	1	190	105	2/2/56	SWS	Adequate
						2	190	105	6/29/67	SWS	
									10/24/67	SWS	
Philo	1,022		90,000	1975	Sand and gravel	2	44	23	5/31/45	SWS	Marginal
						3	28.5	60	3/27/54		
						4	26	32	10/11/62		
Rantoul	25,562		1,800,000	1977	Mahomet Bedrock Valley sand and gravel	3	137	650	12/5/39	SWS	Adequate
						5	291	800			
						6	142	200			
						7	279	1,050			
Royal	197		15,000	1976	Sand and gravel	1	106.5	50	1/9/68	SWS	Adequate
Sadorus	454		21,000	1975	Sand and gravel	1	114	27	6/21/63	SWS	Adequate
						2	112	30	9/6/63	SWS	
Sangamon Valley Public Water District	2,000 (Est. 1973)		187,000	1974	Sand and gravel	1	283.1	300	10/2/67	SWS	Adequate
						2	289	220			
Savoy	592	1,496 (1975)									Village receives water from Northern Illinois Water Corpora- tion in Champaign-Urbana.
Sidney	915		60,000	1976	Sand and gravel	1	56	Standby			Adequate
						2	58.5	125	11/16/54	SWS	
						3	53	50	9/1/77	SWS	
St. Joseph	1,554	1,869 (1975)	174,000	1975	Wisconsinan drift, sand and gravel	1	76	Standby	5/28/58	SWS	Adequate
						2	72.5	50	2/7/64	SWS	
						3	72	160	7/15/71	SWS	
						4	82.5	125	12/27/76	SWS	
Thomnsboro	806		80,000	1976	Mahomet Bedrock Valley sand and gravel	1	230	100	4/18/60	SWS	Adequate
						2	238	100	3/1/66	SWS	
Tolono	2,027		150,000	1974	Illinoian glacial drift, sand and gravel	9	179	150			Adequate
						11	181	150	2/16/66	SWS	
						12	182.5	150	12/20/72	SWS	

11. Christian County

Facility	Population 1970 census	spuc. census	Average daily pumpage (gallons) (yr)	Aquifer description	Well no.	Depth (ft)	Discharge (gpm)	Aquifer test	Aquifer assessment					
Assumption	1,487		140,000 1974	Sand and gravel in the valley of Lake Fork	1	23	18		Adequate					
					2	24	18							
					5	26	13	6/6-7/61 SWS						
					6	26	13	6/7/61 SWS						
					7	30	13	6/11/61 SWS						
					8	31	18							
					9	35	35							
					10	90	No Record	5/16/78 SWS						
					11	105	No Record							
					Edinburg	1,153		97,500 1978	South Fork, Sangamon River Valley alluvium	9	43	35	5/10/61 Marginal	
										10	44	*	4/26/74 SWS	*W#10 and W#11 operated
11	44	*	9/30/74 SWS	simultaneously for 60										
12	42.5	60	4/8/77	gpm total; alternated in use with W//12										
Morrisonville	1,178		85,000 1975	Sand and gravel	4	44	120	6/5/44 SWS	Adequate					
					5	41	120	9/17/52 SWS						
Mt. Auburn	520		35,000 1977	Sand and gravel	1	70	50	4/29/41	Adequate. W#1 alternated					
					2	65	50		in use with W#2 on a weekly basis.					
Palmer	244		10,000 1976	Sand and gravel	1	76	78	5/1/67	Adequate					
Stonington	1,096		90,000 1976	Sand and gravel	9	65	Standby		Adequate. Well #10 is					
					10	124.5	150	2/26/69 SWS	alternated in use with					
					11	104	150	1/24/74 SWS	Well #11 on a weekly basis					
Taylorville	10,644		1,000,000 1978	Sand and gravel	11	88	800		Adequate. Additional 1 to					
					12	90	800		1.6 mgd is obtained from					
					13	96	800		an impoundment reservoir. City supplies water to Langeyville PWD and Owaneco. SWS Report of Investigation 41, published in 1961, rates the long-term yield of Taylorville's aquifer at 1.4 MGD when operated individually.					

12. Clark County

Casey	2,994		408,000 1977	Sand and gravel	6	79.5	125		Adequate
					8	132	100	1/20/66 SWS	
					9	132	100		
					10	71	100	7/2/68 SWS	

Dunlap Water Company	Group	75 (Est. 1976)	3,800	1976	Sand and gravel	1	42.5	30	11/4/71 SWS	Adequate
Marshall	3,463		700,000	1975	Big Creek Valley alluvium	1 2 3	65 64 69.5	650 850 700	6/2/72 SWS	Adequate
Martinsville	1,374		118,600	1977	Sand and gravel	5 6 7 8	58 56 68 76	60 60 60 120	12/28/49 SWS 1/26/50 SWS 4/25/66 8/21/70 SWS	Adequate
Union-York Water District		670 (Est. 1976)	36,000	1976	Sand and gravel	1	115.5	55	11/4/64 SWS	Adequate
Westfield	678		35,000	1974	Sand and gravel	5 6	50 53	33 40	9/14/73 SWS 12/4/75 SWS	Adequate
13. Clinton County										
Albers	656		23,400	1975	Pleistocene Series (sand and gravel)	2 3	184 54	27 60	11/16/56 SWS 2/27/57 SWS	Adequate
					Pennsylvanian System (sandstone)	4 5	59 61.6	70 70	12/2/75 3/17/78 SWS	
Aviston	828		51,000	1976	Sand and gravel	1 2	74 67	98 125	8/4/64 SWS	Adequate
Bartelso	439		26,900	1975	Sand and gravel	1	53	50	6/28/63	Adequate
Damlansville Public Water District		385 (Est. 1975)	8,500	1975	Sand and gravel	3	63	25	8/24/73	Adequate. Aquifer test indicates 10 gpm of long term yield on Well #3.
Cermantown	1,108		56,200	1975	Sand and gravel	1 2	28.5 26	21 34	1/18/56 1/25/56	Marginal
14. Coles County										
Ashmore	428		65,000	1977	Sand and gravel	1 2	42 43.5	80 1	9/14/72 SWS 11/25/74 SWS	Adequate
Lerna	288		18,600	1975	Pleistocene Series (sand and gravel)	1 3	34 138	3 6.5	9/24/58 SWS	Deficient
					Pennsylvanian System. (Sandstone)	4 5 6	151 130 142	3 3 5	9/30/55 SWS 8/6/76 SWS	

15. Crawford County

Facility	Population 1970 census	spec. census	Average daily pumpage (gallons) (yr)	Aquifer description	Well no.	Depth (ft)	Discharge (gpm)	Aquifer test	Aquifer assessment
Flat Rock	504		28,000 1976	Sand and gravel	1	52	90	9/27/56 SWS	Adequate
					2	63	75	12/5/61 SWS	
Hutsonville	544		27,000 1974	Sand and gravel	2	36.5	250	7/28/58 SWS	Adequate
					3	32	300		
Eaton Public Water District		700 (Est. 1972)	17,400 1972						Adequate. See Robinson
Hebron Public Water District		350 (Est. 1976)	16,000 1976						Adequate. See Robinson.
Oblong	1,860		146,000 1972						Adequate. See Robinson.
Stoy	199								Adequate. See Robinson.
Palestine	1,640		85,000 1974						Adequate. See Robinson.
Robinson	7,178		1,340,000 1973	Wabash River Valley alluvium	5	70	250		Adequate. Water is supplied to Eaton PUD, Oblong, Hebron PWD, Palestine, and Stoy.
					7	81	600		
					9	85	600		
					10	84	800		

16. Cumberland County

Greenup	1,618		145,000 1975	Embarrass River Valley alluvium	3	43	140	11/13/50 SWS 9/20/63 SWS 10/20/77 SWS	Adequate
					4	40	40		
					5	41	80		
					6	44	250		
Jewett	211		10,000 1975	Sand and gravel	1	133.5	38	11/15/63 SWS 1/16/64 SWS	Adequate
					2	136	45		
Toledo	1,068		85,000 1978	Cottonwood Creek Valley alluvium	2	20	20	7/28/52 SWS 2/18/75 SWS	Marginal
					3	29	20		
					5	30	90		

17. DeKalb County

DeKalb	32,949	3,918,000	1976	Ordovician-Cambrian Systems (Glenwood - St. Peter Sandstone, Irenton-Galesville Sandstone)	1	133	700	8/23/38 SWS 1/25/52 SWS 1/27/55 SWS 7/21/66 SWS 1/2/68 SWS 8/14/72	Adequate
					4	1,325	495		
					6	1,291	1,000		
					7	1,328	925		
					8	949	620		
					9	1,330	525		
					10	1,310	1,100		
					11	1,312	1,200		
					12	1,200	1,175		

Cenoa	3,003	3,210 (1975)	428,500	1977	Ordovician System	2	730	500	10/15/56 SWS 12/21/70	Adequate
					(Glenwood-St. Peter Sandstone)	3	732	700		
						4	770	1,000		
Hinckley	1,053		115,400	1977	Ordovician System	2	708	300	12/28/63	Adequate
					(Galena-Platteville Dolomite, St. Peter Sandstone)	3	605	300		
Kingston	481		58,600	1977	Ordovician System	2	755	100	12/18/58 SWS	Adequate
					(Galena-Platteville limestone, St. Peter Sandstone)	3	717	300		
Kirkland	1,138		109,400	1976	Ordovician System (Galena-Platteville limestone, Glenwood-St. Peter Sandstone)	1	636	320	10/11/50 SWS	Adequate
Malta	961		65,000	1977	Ordovician-Cambrian Systems (Glenwood-St. Peter Sandstone, Ironton Sandstone)	1	853	100	10/21/52 SWS	Adequate
						2	1,254	300		
Sandwich	5,056		910,000	1975	Ordovician-Cambrian Systems (St. Peter Sandstone, Galesville Sandstone)	1	650	800		Adequate
						2	600	750		
						3	600	750		
Shabbona	730		172,000	1977	Sand and gravel	1	150	100	5/26/59 4/24/72	Adequate
						3	149	200		
						4	163	200		
Somonauk	1,112		100,000	1977	Ordovician System (St. Peter Sandstone)	1	190	300		Adequate
					Ordovician-Cambrian Systems (Oneota, Eminence-Potasi Fms.)	2	502	250		
Sycamore	7,834		1,796,000	1977	Ordovician System (Galena-Platteville Dolomite, St. Peter Sandstone)	1	902	950	7/9/62 7/13/70	Adequate
						3	1,002	600		
						5	1,270	1,000		
						6	1,214	1,000		
Waterman	990		104,100	1976	Pleistocene Series (sand and gravel)	2	72	150	10/21/63	Adequate
					Ordovician System (Galena-Platteville Limestone)	3	400	180		

18. Dewitt County

Facility	Population 1970 census	spec. census	Average daily pumpage (gallons) (yr)	Aquifer description	Well no.	Depth (ft)	Discharge (gpm)	Aquifer test	Aquifer assessment
Clinton	7,570		1,100,000 1974	Mahomet Bedrock Valley sand and gravel	1	327	250		Adequate
					3	357	350		
					4	240	220		
					6	345	500	3/29/60 SWS	
					7	345	800	3/29/60 SWS	
					8		800		
9		300							
Tamer City	2,217		213,000 1975	Wisconsinan and Illi- noian age glacial sand and gravel	2	167	51	10/1/45 SWS	Adequate
								5/2/74 SWS	
					4	167	50	12/9/54 SWS	
								7/13/55 SWS	
								5/6/74 SWS	
					6	172	200	5/7/74 SWS	
					7	180	90	9/11/67 SWS	
					8	152	20	5/23/74 SWS	
			7/20/72 SWS						
			5/3/74 SWS						
Kenney	367		28,000 1974	Sand and gravel	1	248	190	10/26/56 SWS	Adequate
Wapella	572		50,000 1976	Wisconsinan glacial sand and gravel	2	79	60		Adequate
Waynesville	522		42,000 1974	Wisconsinan age Shelbyville moraine sand and gravel	6	217	200		Adequate
					7	162	standby		
Weldon	533		30,000 1974	Illinoian sand and gravel, Mahomet Bed- rock Valley sand and gravel	3	167	70	8/13/63 SWS	Adequate
								6/13/68 SWS	
					4	163	50	10/11/72 SWS	
					5	293	150	4/3/78 SWS	

19. Douglas County

Areola	2,276		146,000 1973	Wisconsinan glacial sand and gravel	2-A	128	56		Adequate. SWS Report of investigation 41, published in 1961, rates the long-term yield of Areola's aquifer at 200,000 gpd.
					5	106	68	8/11/55 SWS	
					6	118	37	12/30/55 SWS	
Arthur	2,214		200,000 1977	Wisconsinan and Illi- noian glacial sand and gravel	1	78	150		Adequate
					2	92	40	3/19/45 SWS	
					3	92	103		
					4	90	35	6/20/45 SWS	
					5	81	45	10/5/64 SWS	
					6	82	65	8/3/71 SWS	

Atwood	1,264	122,000	1976	Wisconsinan and Illinoian glacial sand and gravel	1 2	97 96	100 standby	7/19/35 SWS 8/3/60 SWS	Adequate	
Camargo	241	15,000	1976	Pleistocene Series (Glacial sand and gravel), Pennsylvanian System (shale)	1 2 3	165 80.5 72	20 12 34	4/13/56 SWS 3/15/61 SWS 10/13/71 SWS	Adequate	
Rindsboro	418	25,000	1976	Sand and gravel	1 2 3	83 28 140	15 1 15	10/29/68 SWS 6/13/68 10/29/68 SWS 9/8/71 SWS	Marginal	
Newman	1,018	117,000	1976	Pleistocene Series (Embarrass River alluvium sand and gravel)	3 4	30 58.3	standby 190	11/21- 22-49 SWS 6/22/53 SWS	Adequate	
Tuscola	3,917	5,000 (Est. 1977)	160,000	1978	Devonian and Silurian Systems (limestone)	6 7 9	460 557 696	95 45 82	7/10/64	Adequate. Tuscola purchases an additional 321,000 gpd of treated water from U.S. Industrial Chemical Co. This water is withdrawn from the Kaskaskia River.
Villa Grove	2,605	207,000	1976	Devonian System (Cedar Valley Sandstone)	1 2	645 627	250 250	. 3/11/54 SWS	Adequate	
20. Edgar County										
Brocton	349	25,000	1976	Sand and gravel	1	38	60	5/16/62 SWS	Adequate	
Chrisman	1,285	147,000	1976	Sand and gravel	4 5	96 92	200 250	11/12/53 SWS 3/30/71 SWS	Adequate	
Hume	496	35,000	1977	Sand and gravel	1 2	55 57	75 100	10/26/54 SWS 11/7/75 SWS	Adequate	
Kansas	779	63,000	1977	Sand and gravel	4 5	85 81	100 110		Adequate	
Metcalf	269	12,000	1977	Sand and gravel	1	75	100	2/2/55 SWS	Adequate	
Redmon	251	8,500	1976	Sand and gravel	1	67	50	1/30/67 SWS	Adequate	
Vermilion	333	4,500	1975	Sand and gravel	1 2	54 55	26 27	8/16/56 SWS 8/22/56 SWS	Adequate	

21. Edwards County

Facility	Population 1970 census	Population spec. census	Average daily pumpage (gallons) (vr)	Aquifer description	Well no.	Depth (ft)	Discharge (gpm)	Aquifer test	Aquifer assessment
Albion	1,791		400,000 1975	Wabash River Valley alluvium	1	81.4	200	11/6/62	Adequate
					2	42.8	200	1/30/63 SWS	
					3	54.5	400	5/2/63 SWS 7/8/64 SWS	
Bone Cap	308	28,000	1972	Sand and gravel	1	47	25	2/14/64 SWS	Adequate
					2	91.6	30	3/29/68 SWS	
Grayville	2,035		405,000 1974	Wabash River Valley alluvium	1	72.5	450	12/21/44 SWS	Adequate
					2	71.8	300	12/13/44 SWS	
					3	73	450		

22. Effingham County

Beecher City	466		22,000 1975	Kaskaskia River Valley alluvium	7	33	45	4/21/67 SWS	Adequate
					12	37.5	45	6/30/70 SWS	
Dieterich	550		40,000 1975	Dieterich Creek Valley alluvium	3	33	25		Marginal. Limited aquifer sensitive to drought conditions .
					4	27	40		
					5	24	40		
					6	30	10		
					7	34.5	7		
Edgewood	495		57,500 1976	Pleistocene Series (unconsolidated glacial drift, sand and gravel) Pennsylvanian System (sandstone)	1	16.5	32	2/7/61 SWS	Adequate
					2	23	15	11/2/76 SWS	
					4	160	25		
Montrose	312		12,000 1971	Sand and gravel	1	36	40	7/26/71 SWS	Adequate
					2	44	25	11/3/71 SWS	
Teutopolis	1,249		97,400 1974	Sand and gravel	1	74	30	2/6/41 SWS	Adequate
					2	32	50	3/14/55 SWS	
					3	39	45	3/22/72 SWS	
Watson	276		10,000 1975	Sand and gravel	1	28	15	11/30/60 SWS	Marginal
					2	34	10	11/30/60 SWS	

23. Fayette County

Brownatown	689		55,000 1975	Sand and gravel	1	38	2*		*Adequate. Estimated discharges Combined discharge reportedly 33 gpm.
					2	33	4*		
					3	27	5*		
					4	110	5*		
					5	26	3*		

				7	35	5*				
				9	45	15*				
				11	52	3*				
				12	50	5*				
				13	50	no record				
				14	25	3*				
				15	17	no record				
				21		no record				
Farina	634	35,000	1972	Pennsylvanian System (sandstone)	1	170'	20		Adequate	
					2	135	3.8			
					3	125	2.5			
					4	210	4.2			
					5	133	6.0	6/5/58 SWS		
					6	146	9.0	6/11/59 SWS		
					7	115	6.0	10/4/71 SWS		
					8	110	4.0	5/30/75		
					9	140	6.0	5/22/75		
					10	116	12.0	6/3/75		
Ramsey	830	106,000	1976	Sand and gravel	5	40	200	11/29/71 SWS	Adequate	
24. Ford County										
Cabery	287	40,000	1976	Silurian System (Silurian dolomite, limestone)	2	233	30	3/9/42 SWS	Adequate	
					3	357	100	U/26/56 SWS		
Elliott	365	25,000	1977	Sand and gravel	2	126	60	5/22/50 SWS	Adequate	
Gibson City	3,454	548,400	1975	Sand and gravel	1	58	300	11/19/41 SWS	Adequate	
					2	56	320	6/16/59 SWS		
					3	58	425	9/20/49 SWS		
Kempton	263	15,200	1976	Sand and gravel	2	238	60		Adequate	
					4	238	85	10/16/62 SWS		
Melvin	492	60,000	1975	Sand and gravel	3	258	60		Adequate	
					4	265	140	6/9/54 SWS		
Paxton	4,373	500,000	1973	Mahomet Bedrock Valley sand and gravel	5	149	100	10/10/45 SWS	Adequate	
					6	153	200	7/27/50 SWS		
					7	340	800	11/7-8/56 SWS		
					8	339	800	8/20-21/59 SWS		
Piper City	817	147,000	1975	Sand and gravel	6	90	90	5/29/44 SWS	Adequate	
					7	130	160	10/1/53 SWS		
Roberts	506	23,000	1977	Sand and gravel	5	226	95	9/22/50 SWS	Adequate	
					6	228	120	11/17/60 SWS		
Sibley	381	12,000 (Est. 1950)		Sand and gravel	1	117	58		Adequate	

25. Fulton County

Facility	Population 1970 census	spec. census	Average daily pumpage (gallons) (yr)	Aquifer description	Well No.	Depth (ft)	Discharge (gpm)	Aquifer test	Aquifer assessment
Bryant	326		14,800 1977	Devonian-Silurian Sys- tems (dolomite and limestone) Ordovician System (Galena-Platteville dolomite, limestone)	1	1,282	50	2/24/72 SWS	Adequate
Cuba	1,581		100,000 1976	Silurian System (Niagaran-Maquoketa limestone) Ordovician System (Calena-Platteville dolomite, limestone)	4	1,380	200	4/16/52 SWS	Adequate
Fairview	601		30,000 1976	Devonian-Silurian Systems (limestone and dolomite) Ordovician System (Glenwood-St. Peter Sandstone)	3	1,605	140	1/3/52 SWS	Adequate
Fermington	2,959		265,000 1977	Ordovician System (Galena-Platteville Dolomite, St. Peter Sandstone)	1 2	1,710 1,743	250 250		Adequate
Ipava	608		55,000 1975	Ordovician System (Maquoketa limestone, Galena-Platteville limestone)	1	1,324	250		Adequate
Lewistown	2,706		300,000 1977	Sand and gravel	7 8 9 10 11	35 35 46 46 44.5	90 85 125 225 200	3/23/56 SWS 6/11/71 SWS 5/3/74	Adequate
London Mills	610		65,000 1976	Sand and gravel	1 2	22.8 45	75 75	10/14/41 SWS 6/13/61 SWS	Adequate
Norris	359		23,700 1976	Ordovician System (St. Peter Sandstone)	1	1,702	100	6/13/66 SWS	Adequate
St. David	773		68,600 1976	Sand and gravel	1 2 3	48 43 44	25 25 10	12/1/61 12/1/61 11/8/63	Marginal. Now part of Dunfermline-St. David Water Comm.
Smithfield	318		11,000 1977	Sand and gravel	1	205	50	1/26-27/67 SWS	Adequate
Table Grove	469		18,000 1975	Ordovician System (Galena-Platteville Dolomite, St. Peter Sandstone)	1	1,635	75	10/29/52 SWS	Adequate

26. Gallatin County

Equality	732	84,000	1976	Ohio River Valley alluvium	1	91	60		Adequate
					2	98	100		
New Haven	606	69,000	1973	Wabash River Valley alluvium	1	60	100	8/13/65 SWS	Adequate
					2	56.7	Unknown	6/29/73	
Old Shawneetown	342	10,000	1973	Ohio River Valley alluvium	1	84	50	6/17/64 SWS	Adequate
Rldgway	1,160	65,000	1975	Wabash and Ohio River Valley alluvium	1	85	200	11/10/38 SWS	Adequate
					2	85	50		
Shawneetown	1,742	190,000	1974	Ohio River Valley alluvium	3	101	250	6/25/70 SWS	Adequate
					4	96	250	8/3/72 SWS	

27. Greene County

Carroliton	2.866	180,000	1969	Mississippian System (Keokuk-Burlington Limestone)	Spring		500		Adequate. Discharge from spring varies seasonally.
Eldred	292	21,000	1975	Sand and gravel	1	52	87	6/16/59 SWS	Adequate
					2	56	45		
Hillview	322	17,000	1975	Apple Creek Valley alluvium	1	69.5	50	7/10/68	Adequate
Kane	432	35,000	1975	Sand and gravel	1	59	100	8/17/64	Adequate
Rockbridge	256	8,600	1973						Adequate. Water is obtained from Medora, Macoupin County
Roodhouse	2,357	300,000	1975	Mississippian System (Keokuk-Burlington Limestone)	1	150	Standby	6/20/72 SWS	Adequate
					2	150	550	6/20/72 SWS	
					(No. Well)				
					(So. Well)				
Wilmington	141								Adequate. Water is obtained from Roodhouse.

28. Grundy County

Draceville	66S	30,000	1976	Ordovician System (St. Peter Sandstone) Plei- stocene Series (sand and gravel)	1	868	33	10/16/63 SWS	Adequate
					2	79	12	3/1/77 SWS	
					3	105	No record		
Carbon Hill	317	25,000	1976	Ordovician System (St. Peter Sandstone)	2	650	20		Adequate
					3	800	100	5/6/66	

Facility	Population		Average daily		Aquifer description	Well no.	Depth (ft)	Discharge (gpm)	Aquifer test	Aquifer assessment
	1970 census	spec. census	(gallons)	(yr)						
Coal City	3,040		421,000	1977	Ordovician System, (Galena limestone)	3	360	390		Adequate
					St. Peter Sandstone)	4	793	250	7/29-30/69 1/23/78	
						5		No record	6/14-16/78	
Diamond	452		64,300	1977	Ordovician System (St. Peter Sandstone)	1	723	103	9/26/59	Adequate
Eileen	371		38,000	1976	Ordovician System (St. Peter Sandstone)	1	700	70		Adequate
Cardner	1,212		93,700	1977	Ordovician System (St. Peter Sandstone)	1	173	50		Adequate
						2	161	112	10/6-7/44	
					Pennsylvanian System (limestone)	3	972	45	7/5/39 SWS 9/11-12/39 SWS	
					Pleistocene Series (sand and gravel)	4	1,933	600	3/17/51 SWS 10/7/68	
Kinsman	153		15,000	1976	Ordovician System (St. Peter Sandstone)	1	700	Standby		Adequate
						2	785	50		
Mazon	727		75,000	1978	Sand and gravel	1	25	45		Adequate. Construction features of W#4 are unknown.
						2	26	25		
						3	26	40		
						4	*	6		
Minooka	768	934 (1972)	150,000	1977	Ordovician System (St. Peter Sandstone)	3	1,508	300	5/19-20/65	Adequate
					Cambrian System (Galesville Sandstone)	4	725	140	8/14/73	
Morris	8,194	8,435 (1972)	1,250,000	1977	Cambrian System (Galesville Sandstone)	3	720	900		Adequate
						4	1,501	800		
					Ordovician System (St. Peter Sandstone)	5	1,000	1,462	5/11-13/54 SWS	
Ridgecrest Utility Co. Inc. (Sub- division)		567 (Est. 1974)	23,000	1972	Ordovician System (dolomite and limestone)	1	650	150	12/10/65	Adequate
South Wilmington	725		45,000	1976	Ordovician System.	3	993.5	40	5/31/50	Adequate
					(St. Peter Sandstone)	4	970	70	10/7/66	
29. Hancock County										
Bowen	489		42,000	1974	Mississippian Bedrock	2	345	15	7/7/48 5/5-6/52	Adequate
						3	72	25		
						4	68	25		
						5	70	25		

Carthage	3,350	300,000	1975	Burled valley sand and gravel	1 2	204 189	175 100		Adequate. Surface reservoir is the main source of water supply. Groundwater is used only for supplemental or emergency purposes.
LaHarpe	1,240	90,000	1972	Buried valley sand and gravel	1	89.5	135	9/6/77	Adequate. Ground water will be used only to supplement surface water supply.
Plymouth	740	65,000	1976	Sand and gravel	1 2	67 68	100 100	2/13/64 SWS	Adequate
30. Hardin County									
Cave-in-Rock	503	27,500	1974	Mississippian System (St. Louis Limestone)	1	220	130	3/16/61 SWS	Adequate. Aquifer is hydraulically connected with Ohio River. Well capacity depends on the Ohio River pool level.
Elizabethtown	707				1	396	12		Village considered P.W.S. in 1977, drilled Well #1. No detailed record yet.
Hardin County Water District	615 (Esc.)	12,000	1972	Ohio River Valley alluvium	1	84.5	50	8/14/70 SWS	Adequate
31. Henderson County									
Biggsville	391	60,000 (Est.)	1971	Mississippian System (Keokuk-Burlington Limestone) Ordovician System (Maquoketa Shale)	1 2	891 950	Standby 250		Adequate. There is no record of actual consumption, as there is no master meter in the distribution. However, Geological Survey's description of aquifer shows supply should be adequate.
Media	180	12,000	1976	Mississippian System (Keokuk-Burlington Limestone)	1	70	80		Adequate
Oquawka	1,352	160,000	1977	Mississippi River Valley alluvium	1 2	50 140	300 500		Adequate
Raritan	206	8,000	1976	Devonian System (limestone) Ordovician System (Maquoketa Shale, Galena-Platteville Dolomite)	1	964	50	12/15/64 SWS	Adequate

Facility	Population 1970 census	spec. census	Average daily pumpage (gallons) (yr)	Aquifer description	Well no.	Depth (ft)	Discharge (gpm)	Aquifer test	Aquifer assessment
Strenghurst	836		73,000 1976	Mississippian System	1	1,009	112		Adequate
				(Keckuk-Burlington Limestone)	3	69	120		
					4	70	90		
				Ordovician System (Glenwood-St. Peter Sandstone)					
32. Henry County									
Alpha	771		76,000 1976	Devonian and Silurian	1	1,364	120	1/16/50 SWS	Adequate
				Systems (limestone) Ordovician System (Galena- Platteville limestone, St. Peter Sandstone)	2	1,209	100		
Andover	420		45,000 1976	Silurian System (dolomite)	1	677	110	6/25/54 SWS	Adequate
Annawan	787		110,000 1977	Silurian System (dolomite)	1	603	150	6/2/47 SWS	Adequate
					2	603	150	6/18/70 SWS	
Atkinson	1,053		126,000 1977	Devonian System (limestone)	1	1,123	200		Adequate
					2	604	175		
Bishop Hill	191		30,000 1976	Silurian System (limestone)	1	675	50	8/6/62 SWS	Marginal
Cambridge	2,095		206,000 1977	Devonian-Silurian Sys- tems (limestone) Ordovician System (Maquoketa limestone, Galena limestone)	2	1,377	225		Adequate
					3	1,410	350		
Colona	1,293		176,000 1977	Silurian System (dolomite)	1	492	100	4/5/56 SWS	Marginal
					2	445	250		
East Portal Water System		315 (Est. 1976)	17,000 1976	Silurian System (limestone)	1	470	100		Adequate
Galva	3,061		494,000 1976	Silurian System (dolomite) Ordovician System (Galena-Platteville Dolomite, Shakopee dolomite)	3	1,524	500		Adequate
					4	1,687	500		
Geneseo	5.840	588.000	1976	Green River Valley alluvium	E-1	20	100	7/15/47 SWS	Adequate
					E-3	65' 4"	300		
					F-1	18	100		
					25	65	600		
					26	60	50C		
							4/1/66		

Green Rock	2,744		153,000	1976						Water is obtained from Colona PWS.
Keweenaw	15,762		1,300,000	1977	Silurian System (Niagaran-Alexandrian dolomite)	1	2,497	800		Adequate
					Ordovician System (Calena-Platteville Dolomite)	2	2,430	700		
					Cambrian System (Franconia sandstone and dolomite)	3	2,484	500	8/30-31/39	SWS
						4	2,501	1,050	9/13-14/65	SWS
Lynn Center Water Association		115 (Est. 1974)	11,000	1974	Silurian System (limestone)	1	686	35		Adequate
Ophiem		115 (Est. 1976)	12,000	1976	Devonian-Silurian Systems (limestone)	1	370	70		Adequate
Orion	1,801	1,192 (1975)	180,000	1976	Devonian-Silurian Systems (limestone, dolomite)	1	615	120		Adequate
						2	521	150		
Osco		112 (Est. 1974)	10,000	1974	Silurian System (dolomite)	1	400	18		Marginal
Woodhull	898		100,000	1976	Ordovician System (Maquoketa Shale, St. Peter Sandstone)	1	1,390	180		Adequate
						2	1,369	120		
33. Iroquois County										
Ashkum	590	694 (1974)	50,000	1974	Silurian System (Niagaran limestone)	1	196	84	5/28-29/47	SWS Adequate
						2	147	60		
						3	215	100	6/23/77	SWS
Beaverville	442		20,000	1975	Silurian System (limestone)	1	200	130	8/8/49	SWS Adequate
						2	203	110	9/28/65	SWS
Buckley	680		68,900	1977	Sand and gravel	3	152	110	4/20/48	Adequate
						4	152	110	11/13/58	
Chebanse	1,185		200,000	1974	Pleistocene Series (sand and gravel)	1	152	206	2/23/49	SWS Adequate
					Silurian System (dolomite)	2	150	300	4/9/57	SWS
Cissna Park	773		75,000	1977	Wisconsinan glacial deposits	5	176	400	10/13/66	Adequate
						6	176	100	12/17/74	
Clifton	1,339		134,000* (Est)		Silurian System (dolomite)	1	137	250	8/29/41	SWS Adequate. *No record of actual consumption, based on daily per capita consumption of 100 gal.
						2	143	250	9/24/56	

Facility	Population 1970 census	Population spec. census	Average daily pumpage (gallons) (yr)	Aquifer description	Well no.	Depth (ft)	Discharge (gpm)	Aquifer test	Aquifer assessment
Crescent. City	579		25,000 1975	Sand and gravel	2	132	200		Adequate
					3	145	150		
Danforth	404		35,000 1974	Sand and gravel	6	210	30	1/24/56 SWS	Adequate
					8	100	110	1/21/71 SwS	
					9	100	106	5/14/71 SWS	
Donovan	343		24,000 1972 *(Est.)	Sand and gravel	1	130	100	10/22/70	Adequate. *No master meter to measure actual con- sumption.
					2	170	44		
Gilman	1,786		185,000 1977	Sand and gravel	1	195	400	8/20/52 SWS	Adequate
					2	197	350	9/9/60 SWS	
Loda	525		35,000 1974	Sand and gravel	1	156	145	9/5/40 SWS	Adequate
					2	158	150	6/13/51 SWS	
Martinton	278		28,000 1970 *(Est.)	Devonian-Silurian Systems (dolomite and limestone)	1	265	280		Adequate. *No master meter Based on 100 gallons per day per capita consumption,
Milford	1,656		214,000 1974	Sand and gravel	6	70	125	11/20/63 SWS	Adequate
					7	79	225		
					8	80	800		
Onarga	1,436		135,000 1977	Sand and gravel	1	156	55	5/25/73 SWS	Adequate
					3	165	240		
Sheldon	1,455		146,000 1970 *(Est.)	Sand and gravel	4	116	350		Adequate. *No master meter Based on 100 gallons per day per capita consumption,
					5	112	125		
Thawville	271		23,000 1977	Sand and gravel	1	120	75	8/9/50 SWS	Adequate
Watseka	5,294		530,000 1973 *(Est.)	Sand and gravel	3	168	350	6/10/52 SWS 6/5/61 SWS 8/13/74	Adequate. *No master meter. Based on 100 gallons per day per capita consumption.
					4	160	200		
					5	175	350		
					6	160	400		
					7	133	400		
Wellington	410		22,000 1977	Sand and gravel	1	123	50	9/5/68 SWS	Adequate
Woodland	350		350,000 1970 *(Est.)	Sand and gravel	2	107	Standby		Adequate. *No master meter. Based on 100 gallons per day per capita consumption.
					4	122	55		
					5	124	100		
34. Jackson County									
Gorham	361		27,500 1975	Mississippi River Valley alluvium	1	89	80	7/7/60 SWS	Adequate

Grand Tower	664	786 (1971)	65,000	1975	Mississippi River Valley alluvium	1 2	156 155	75 150	8/3/51 SWS 8/31/71 SWS	Adequate
-------------	-----	---------------	--------	------	--------------------------------------	--------	------------	-----------	---------------------------	----------

35. Jasper County

Newton	3,024		324,000	1975	Illinoian glacial drift, sand and gravel	1	57.3	125		Adequate. Water obtained from the Embarras River and/or from three wells.
						2	53	125	4/2/64 SWS	
						3	52	125	4/8/64 SWS	
St. Marie	335		18,000	1975	Embarras River Valley alluvium	1	54	70	8/19/65 SWS	Adequate
						2	53.5	35	10/24/68 SWS	
Willow Hill	296		8,000	1975	Pennsylvanian System (sandstone)	1	295	5	12/11/63 SWS	Adequate
						2	275	5	1/21/64 SWS	
						3	269	20	11/11/64 SWS	

36. Jersey County

Crafton	1,018		80,000	1976	Mississippi River Valley alluvium	2	56	166	3/17/69 SWS	Adequate
Jerseyville	7,446		550,000	1975	Illinois River Valley alluvium	1	96	900	2/12/64 SWS	Adequate. Jerseyville supplies water also to Fieldon and Nutwood Water District.
						2	99	900	2/13/64 SWS	

37. Jo Daviess County

Apple River	482		88,000	1977	Ordovician System (Galena-Platteville dolomite and limestone, St. Peter Sandstone)	1	380	155	9/19/41 SWS	Adequate
East Dubuque	2,408		280,000	1976	Mississippi River Valley alluvium. Cambrian System (Eau Claire sandstone and dolomite)	2	1,502	Standby		Adequate
						3	104	600		
Elizabeth	707		81,000	1977	Ordovician System (Galena-Platteville limestone, St. Peter Sandstone)	1	600	Standby		Adequate
						2	317	170		
Calena	3,930		1,400,000	1976	Ordovician System (St. Peter Sandstone) Cambrian System (Eau Claire sandstone, Mt. Simon Sandstone)	3	1,575	Standby		Adequate
						4	1,515	840		
						5	1,100	1,600	3/19/63 SWS	
Hanover	1,243		146,000	1976	Cambrian-Ordovician Systems (St. Peter Sandstone, Galesville Sandstone)	1	1,090	Standby		Adequate
						2	1,132	500		

Facility	Population 19 70 census	spec. census	Average daily pumpage (gallons) (yr)	Aquifer description	Well no.	Depth (ft)	Discharge (gpm)	Aquifer test	Aquifer assessment
Scales Hound	382		28,000 1976	Ordovician System (Galena-Platteville Dolomite, St. Peter Sandstone)	2 3	374 451	150 160		Adequate
Stockton	1,930		476,000 1977	Ordovician System (Calena-Platteville Dol- omite, St. Peter Sand- stone) Cambrian System (Galesville Sandstone, Eau Claire sandstone)	4 5 6	1,277 922 1,088	380 270 570	7/21/53 SWS 3/24/53 SWS .	Adequate
Warren	1,523		160,000 1977	Cambrian-Ordovician Sys- tems (Shakopee dolomite and sandstone, Franconia sandstone, Ironton Sandstone)	2 3	963 1,000	285 270		Adequate
38. Kankakee County									
Aroma Park	896		117,000 1977	Silurian System (Joliet limestone)	2 3	299 4 32	Standby 115	12/11-13-62 SWS	Adequate
Buckingham	198		21,100 1977	Silurian System (Niagaran-Alexandrian limestone)	3	240	52	1/25/49 SWS 4/18/49	Adequate
Grant Park	914		138,000 1977	Silurian System (Racine-Waukashau- Joliet Dolomite)	3 4	330 504	240 290	1/20/49 SWS	Adequate
Herscher	988	1,127 (1974)	121,000 1977	Silurian System (Niagaran-Alexandrian dolomite)	5 6 7	789 773 163	160 160 220	2/21/75 SWS	Adequate
Manteno	2,864		263,000 1977	Silurian System (Niagaran-Alexandrian limestone)	1 2 3	97 310 279	250 325 210	5/31/64 SWS	Adequate
Momence	2,836		426,000 1977	Silurian System (Niagaran dolomite)	1 2 3 4	125 125 175 175	450 650 500 500	9/11/57 10/2/57	Adequate
Roddick	247		13,600 1977	Ordovician System (St. Peter Sandstone)	1	1,188	54	6/22/54 SWS	Adequate
St. Anne	1,271		163,000 1977	Silurian System (Niagaran-Alexandrian limestone)	2 3	265 240	350 500		Adequate

Facility	Population 1970 census	spec. census	Average daily pumpage (gallons) (yr)	Aquifer description	Well no.	Depth (ft)	Discharge (gpm)	Aquifer test	Aquifer assessment
Knoxville	2,930		328,000 1977	Ordovician System	1	1,375	240		Adequate
				(St. Peter Sandstone)	2	2,495	300		
				Cambrian System (Franconia Sandstone)	3	2,525	450	3/29/60	
Maquon	374		20,000 1977	Mississippian System (Keokuk-Burlington lime- stone) Devonian- Silurian Systems (lime- stones and dolomite)	1	638	60	10/10-13/52 SWS	Adequate
Oak Run Development		300 (Est. 1977)	40,000 1977	Devonian-Silurian Systems (limestones and dolomite)	1	802	125		Adequate
Oneida	728		72,800 1970 *(Est.)	Silurian System (dolo- mite) Ordovician System (Galena-Platteville Dolomite)	1 2	840 1,202	100 150	4/8/70 SWS	Adequate. *No master meter. Based on 100 gallons per day per capita consumption.
Rio	136		24,000 1977	Devonian System (Cedar Valley-Wapsipinicon Limestone) Silurian System (dolomite)	1	675	90	12/8/58 SWS	Adequate
St. Augustine	204		12,000 1976	Pennsylvanian System (limesDbne)	1 2	160 871	20 20	4/29/60 SWS	Adequate
Victoria	441		27,000 1977	Devonian System (Cedar Valley-Wapsipinicon Limestone) Silurian System (Niagaran- Alexandrian dolomite)	1	860	63	4/24/50	Adequate
Wataga	570		60,000 1977	Devonian System (Wapsi- pinicon Limestone) Silurian System (Niagaran dolomite)	1	840	125	12/13/54 SWS	Adequate
Williamsfield	552		40,000 1977	Devonian System (Wapsi- pinicon Limestone)	2	887	125		Adequate
				Silurian System (Niagaran-Alexandrian dolomite)	3	880	125	3/6/70	
Yates City	840		80,000 1977	Pleistocene Series (glacial drift, sand and gravel) Ordovician System (St. Peter Sandstone)	1 3	100 1,580	Standby 200		Adequate

41. La Salle County

Cedar Point	304	45,800	1977	Ordovician System (Galena-Platteville Dolomite)	1	1,750	100		Adequate
Earlville	1,410	123,000	1976	Cambrian-Ordovician Systems (St. Peter Sandstone, Eminence-Potosi, Franconia Fms.)	2 3	150 625	Standby 450		Adequate
Crand Ridge	698	116,300	1976	Sand and gravel	1 3	162 190	120 250	1/31/62 SWS	Adequate
Harding	140 (Est.) 1976	7,500	1976	Ordovician System (St. Peter Sandstone)	1	180	20	10/10/73 SWS	Adequate. Aquifer analysis indicates capacity of 150 gpm for this well.
Jonesville	434 (Est.) 1977	27,000	1977						Adequate. Water is obtained from Oglesby public water supply.
Kangley	290	15,000	1977	Ordovician System (St. Peter Sandstone)	1	542	100	9/25/58 SWS	Adequate
Lake Holiday Subdivision	1,348 (Est) 1976	58,100	1976	Cambrian System (Franconia dolomite Galesville Sandstone)	1 2	663 . 708	250 Standby	7/19/65 SWS 9/9/65 SWS	Adequate
LaSalle	10,620	3,150,000	1976	Unconsolidated glacial drift	3 4 5 6 7	39 58 60 56 49	850 1,600 1,600 1,800 1,500	11/16-17/66 12/28-29/66	Adequate. All are dug wells.
Leland	743	65,000	1976	Mississippian System (Keokuk-Burlington Limestone)	1 2	230 220	100 100		Adequate
Lenore	196	17,900	1976	Sand and gravel	1 2	40 92	300 18		Adequate
Lostant	465	42,300	1977	Ordovician System (Galena-Platteville limestone, Glenwood-St. Peter Sandstone)	4	1,881	80	9/10-11/53 SWS	Adequate
Marseilles	4,320	600,000	1976	Ordovician System (One-ota Dolomite) Cambrian System (Eminence-Potosi Delemite)	2 3 4	670 850 1,466	Standby 200 600		Adequate
Mendota	6,902	1,183,000	1376	Ordovician System (St. Peter Sandstone)	3 4 5	534 1,360 Standby	800 1,280 600	8/22-23/45 SWS 5/3-4/57 SWS	Adequate

Facility	Population 1970 census	3pec. census	Average daily pumpage (gallons) (yr)	Aquifer description	Well no.	Depth (ft)	Discharge (gpm)	Aquifer test	Aquifer assessment
Naplate	686		39,000 1976	Ordovician System (Shakopee Dolomite, New Richmond Sandstone)	1	420	140	5/19/69 SWS	Adequate
Oglesby	4,175		493,000 1977	Ordovician System (Galena-Platteville Dolomite, Oneota Dolo- mite) Cambrian System (Ironton-Galesville Sandstone)	3 4	2,821 2,795	1,000 1,000	4/2/49 SWS 4/1-2/59 SWS	Adequate
Ottawa	18,716		1,870,000 1976	Ordovician System (Oneota Dolomite) Cambrian System (Franconia dolomite, Galesville Sandstone)	8 10 11	1,180 1,220 1,203	1,360 905 1,500	11/10/70 10/1/71 6/28/73 SWS	Adequate
Peru	11,772		1,827,000 1976	Ordovician System (Calena-Platteville Dolomite) Cambrian System (Galesville Sandstone)	5 6 7	2,601 2,665 2,591	1,000 1,200 1,000	2/22/52 SWS 11/20-21/63 SWS	Adequate
Ransom	440		41,500 1977	Ordovician System (St. Peter Sandstone)	1 2 3 4	325 831 280 812	Standby 10 Standby 40.5	8/30/71 SWS	Adequate
Rutland	437		50,000 1977	Sand and gravel	3 4	No data 55	40 50		Adequate
Seneca	1,781		189,000 1976	Ordovician System (Glenwood-St. Peter Sandstone, Oneota Dolomite)	1 2	700 704	250 300	9/24/43	Adequate
Tonica	821		35,000 1976	Sand and gravel	2 3 4	193 193 205	25 Standby 175	8/25/53	Adequate
North Utica	974		153,900 1976	Ordovician System (Oneota Dolomite) Cambrian System (Galesville Sandstone)	1 2	618 1,078	300 500	8/11/75 SWS	Adequate
42. Lawrence County									
Birds-Pinkstaff Water District		800 (Est. 1972)	64,800 1978	Sand and gravel	1	82	50	1/17/69 SWS	Marginal. 24-hour opera- ation.

Bridgeport	2,262	240,000	1974						Adequate. Water is obtained from the Lawrenceville PWS.
Lawrenceville	5,863	1,000,000	1974	Wabash River Valley alluvium	6 8 9 10	78 .80 81 80	500 800 850 500		Adequate
Petrolia Water District	752 (Est. 1973)	31,800	1973						Adequate. Water is obtained from the Lawrenceville PWS.
St. Francisville	997	70,000	1976	Wabash River Valley alluvium	1 3 4 7	134 136 160 42	Standby Standby Standby 200	9/28/51 SWS 9/31/61 SWS 10/31/75 SWS	Adequate
Sumner	1,201	100,000	1974						Adequate. Water is obtained from the Lawrenceville PWS.
43. Lee County									
Amboy	2,184	248,000	1976	Ordovician System (St. Peter Sandstone) Cambrian System (Galesville Sandstone)	2 3	1,100 1,105	350 680	12/5/38 SWS 1/24/58 SWS	Adequate
Ashton	1,112	189,000	1977	Cambrian System (Eminence-Potosi Dolomite)	1 2	545 249	250 325	11/27/41 SWS	Adequate
Compton	399	60,000	1977	Sand and gravel	2 3	335 332	57 90		Adequate
Dixon	18,147	2,200,000	1977	Ordovician System (St. Peter Sandstone) Cambrian System (Mt. Simon and Fond du Lac Sandstones)	3 5 6 7 8	1,865 1,700 1,720 1,870 1,872	900 1,300 600 1,200 1,300	8/7/57 SWS 9/11/57 SWS 1/3/61 SWS 8/11-12/70 SWS	Adequate
Franklin Crove	968	70,000	1977	Ordovician System (New Richmond Sandstone) Cambrian System (Galesville Sandstone)	1 2 3	298 150 769	85 Standby 140		Adequate
Harmon	205	20,300	1977	Ordovician System (Glenwood-St. Peter Sandstones)	9	950	250		Adequate
Lee	252	75,000	1977	Sand and gravel	1 2	325 338	85 150	12/30/64 SWS	Adequate

Facility	Population 1970 census	spec. census	Average daily pumpage (gallons) (yr)	Aquifer description	Well no.	Depth (ft)	Discharge (gpm)	Aquifer test	Aquifer Assessment
Paw	846		160,900 1977	Cambrian System (Galesville Sandstone)	1 2	1,018 1,033	180 400	9/20/71	Adequate
Steward	308		26,600 1977	Ordovician System (St. Peter Sandstone)	1 2	100 400	40 200	11/7/72 SWS	Adequate
Sublette	361		35,500 1977	Ordovician System (St. Peter Sandstone)	1 2	752 771	25 350	11/1/61 SWS	Adequate
Vest Brooklyn	225		10,000 1977	Ordovician System (St. Peter Sandstone)	4	675	100		Adequate
44. Livingston County									
Campus	215		20,000 1975	Sand and gravel	2	174	100		Adequate
Chatsworth	1,255		128,000 1977	Sand and gravel	2 3 4 5	67 99.5	100 100 200 200	5/17/49 6/6/58 SWS 6/21/60 SWS 9/19/60 SWS	Adequate
Cornell	532		26,000 1974	Sand and gravel	1	99	95	7/7/53 SWS	Adequate
Cullom	572		65,000 1976	Sand and gravel	2 3	152.5 145	125 130	8/29/47 SWS 9/14/61 SWS	Adequate
Dwight	3,841		425,000 1978	Sand and gravel	1 4 5 6	140 140 142 132	267 367 371 490	4/28/71 SWS	Adequate
Emmington	101		5,000 1975	Pennsylvanian System (limestone)	1	550	50	7/9/71 SWS	Adequate
Fairbury	3,359		530,000 1977	Sand and gravel	1 2 3 4	39 40 57 52	240 160 220 350	7/9/62 SWS 6/7/60 SWS 12/7/76 SWS	Adequate
Flanagan	976		68,000 1974	Sand and gravel	2 3 4	168 164 173.5	100 60 50	7/13/72 SWS 6/30/77 SWS	Adequate
Forrest	1,219		115,000 1975	Sand and gravel	1 2 3	114 102.3 104.5	370 370 202	4/8/35 SWS	Adequate
Odell	1,076		90,000 1974	Cambrian System (Err. ir. enee--Potosi Dolomite)	3	1,940	300	5/1-2/51 SWS	Adequate

Saunemin	415	27,000	1976	Sand and gravel	4	39.3	Standby	10/22/63 SWS	Adequate	
					5	183	30	10/10/69 SWS		
					6	184	115	7/26/77 SWS		
Strawn	144	10,000	1975	Sand and gravel	1	60	34		Adequate	
45. Logan County										
Atlanta	1,640	140,000	1976	Sand and gravel	1	191	110		Adequate	
					2	147	90			
					3	157	40	6/21/62 SWS		
					4	150	95	11/4/65 SWS		
Beason-Chestnut	500 (Est. 1978)	27,500	1978	Sand and gravel	1	50	110	8/11/72 SWS	Adequate	
Droadwell	159	12,000	1975	Sand and gravel	1	47	45		Adequate	
					2	53	45			
Elkhart	435	55,000	1976	Sand and gravel	1	75	Standby		Adequate	
					2	77	60	9/19/68 SWS		
Emden	552	35,000	1977	Sand and gravel	1	124	150	10/2/40	Adequate	
Hartsburg	363	25,000	1976	Sand and gravel	1	97	28	5/5/48 SWS	Adequate	
					3	103	45	7/2/71 SWS		
Latham	361	48,000	1977	Sand and gravel	2	72.5	20	8/13/53 SWS	Adequate	
					3	72	15	2/7/63 SWS		
					4	66	30	7/24/68 SWS		
					5	70	.30	6/15/72 SWS		
					6	74.5	100	11/12/75 SWS		
Lincoln	17,582	3,000,000	1977	Sand and gravel	5	45	300		Adequate. Dug well	
					6	54	750		Dug well	
					7	45	750		Dug well	
					8	33	300		Used only during summer	
					9	50	500			
					10	49	200			
					11	50	600			
					12	60	1,000			
Middletown	626	39,000	1975	Sand and gravel	1	155	150	4/14/41 SWS	Adequate	
					2	145.5	200	6/8/73 SWS		
Mt. Pulaski	1,677	175,000	Feb. 1978	Sand and gravel	1	80	Standby	9/17/59	Adequate	
					3	104	Standby	3/10/54		
					4	34	85	8/3-5/60		
					5	32	125	7/10/63 SWS		
					6	38.5	150	1/29/76 SWS		
Now Holland	321	30,000	Feb. 1978	Sand and gravel	1	72	50		Adequate. Well #1 alternates with W #2.	
					2	74	50			

46. Macon County

Facility	Population 1970 census	spec. census	Average daily pumpage (gallons) (vr)	Aquifer description	Well no.	Depth (ft)	Discharge (gpm)	Aquifer test	Aquifer assessment
Argenta	1,034		75,000 1977	Sand and gravel	1	230.5	85	3/10/54 SWS	Adequate
					2	251	100	8/21/61 SWS	
Blue Mound	1,181		98,000 1974	Sand and gravel	1	55	50	1/6/69 SWS	Adequate
					2	58	45	2/28/69 SWS	
					3	88	300	6/10/70 SWS	
Forsyth	585		45,200 1977	Sand and gravel	1	104	135	4/1/66	Adequate
					2	110.5	70	8/3/71	
Harristown		1,165 (1969)	* 139,000 1977	Wisconsinan sand and gravel	1	31	200	4/28/75 SWS 9/21/77	*No record of system operation yet.
Long Creek Water District		3,000 (Est. 1977)	139,000 1977	Sand and gravel	1	105.5	300	1/20/76 SWS	Adequate
Macon	1,249		81,000 1973	Wisconsinan sand and gravel	2	128	111		Adequate
					3	128	111	7/13/60 SWS	
					4	62.5	154	8/29/62 SWS	
					5	88	200	10/4/77 SWS	
Maroa	1,467		120,000 1976	Sand and gravel	1	86	45		Adequate
					2	292	110	12/2/76 SWS	
					3	290	110	12/6/76	
Niantic	705		77,000 1977	Sand and gravel	1	48	20	7/24/50	Adequate
					3	48	74		
					4	51	-	11/15/74 SWS	
Orease	1,092		62,000 1977	Sand and gravel	1	131.5	60	7/31/58 SWS	Marginal
					2	132	110	1/21/65 SWS	
Warrensburg	811	1,165 (1974)	85,000 1974	Sand and gravel	1	118	125	3/12/75 SWS	Adequate
					2	132	152	1/3/56 SWS	

47. Macoupin County

Chesterfield	262		15,000 1976	Sand and gravel	1	50	35	2/29/68 SWS	Adequate
Medora	505		50,000 1975	Sand and gravel	1	54	50	3/5/63 SWS	Adequate
					2	50	50	6/19/72 SWS	

48. Madison County

Alhambra	594		40,700 1975	Silver Creek Valley alluvium	1	80	133	6/6/55 SWS	Adequate
					2	82	130	10/26/71 SWS	
					3	82	100	1/23/78 SWS	

Bethalto	7,074	8,001 (1974)	1,248,500	1976	Mississippi River Valley alluvium	1	93.5	190	3/11/42	SWS	Adequate	
						2	92	240	3/24/42	SWS		
						3	96	400				
						6	95	500	4/21/64	SWS		
						7	90	460	2/20/70	SWS		
						8	91	650	7/28/71	SWS		
						9	92	700	7/28/71	SWS		
						10	98.4	-	3/7/78			
						11	91.5	-	3/2/78			
												Well #10 and Well #11 are not in operation yet.
						Collinsville	19,567		2,070,000	1975		Mississippi River Valley alluvium
8	99	900	1/11/57									
9	102	900										
10	103	900	8/12/58									
East Alton	7,309	7,665 (1972)	568,600	1975	Mississippi River Valley alluvium	1	90	500	9/8/67	SWS	Adequate	
						2	91.5	500	8/31/67	SWS		
						3	103	500	8/23/67	SWS		
Edwardsville	11,070		1,334,600	1975	Mississippi River Valley alluvium	3	114	950			Adequate	
						4	116.5	650				
						5	115	1,050				
						7	117	1,500	7/28/72	SWS		
Forest Homes - Maple Park Public Water District		1,855 (Est. 1975)	75,000	1975	Mississippi River Valley alluvium	1	67	80	11/9/59		Adequate	
						2	66	80	1/19/60			
Glen Carbon	1,897	3,082 (1975)	304,700	1975	Mississippi River Valley alluvium	4	106	430	4/19/63	SWS	Adequate	
						5	99	450	11/28/66	SWS		
						6	105	500	9/30/77	SWS		
Hamel	454		75,000	1977	Sand and gravel	1	113	40			Marginal. 4/7/78 report says this 3-well aquifer has sustained yield of 50-60 gpm.	
						2	113	40	8/18/67	SWS		
						3	110	45	9/1/76	SWS		
Hartford	2,243		393,800	1974	Mississippi River Valley alluvium	1	115	276			Adequate	
						2	106	300				
						3	107	400	5/17/71	SWS		
						4	106	600	8/26/77	SWS		
Livingston	916		61,200	1975	Sand and gravel	6	140	80	2/24/65	SWS	Adequate	
Marine	882		58,700	1975	Sand and gravel	1	90	43			Marginal	
						2	85.5	80	11/8/63	SWS		
Maryville	1,067	1,290	200,000	1975	Mississippi River Valley alluvium	1	100	150	9/14/64	SWS	Adequate	
						2	102	150	9/15/64	SWS		
Meadowbrook PWD		1,575 (Est. 1976)	72,400								Adequate. Water is ob- tained directly from Bethalto PWS.	

Facility	Population 1970 census	spec. census	Average daily pumpage (gallons) (yr)	Aquifer description	Well no.	Depth (ft)	Discharge (gpm)	Aquifer test	Aquifer assessment
Moro PWD		455 (Est. 1974)	16,000 1974						Adequate. Water is obtained directly from Bethalto PWS.
Roxanna	1,882		624,100 1975	Mississippi River Valley alluvium	1 5 6 7	126 126.5 120 120	Standby Standby 500 500	3/25/37 SWS 5/10/66 4/9/69 SWS 4/4/69 SWS	Adequate
St. Jacob	659		37,000 1977	Pennsylvanian System (sandstone)	4 5	182 188	13 25	5/16/56 SWS 9/29/66 SWS	Adequate
South Roxana	2,241		152,800 1975						Adequate. Water is obtained from Roxana PWS.
Troy	2,144		623,200 1974	Mississippi River Valley alluvium	1 2	115 115	300 410	2/25/53	Adequate
Wood River	13,186		1,283,600 1975	Mississippi River Valley alluvium	1 2 3 4	78.7 78.6 86 85.6	1,000 1,000 850 950	1/24/64 SWS 1/29/64 SWS 1/2/64 SWS 2/3/64 SWS	Adequate
Worden	1,091		75,000 1978	Cahokia Creek Valley alluvium	1 7 8	46 43 46	20 20 35	2/14/55 SWS 6/4/69 SWS 5/5/75 SWS	Marginal
49. Marion County									
Iuka	343		15,500 1973	Pennsylvanian System	1 2	77.7 79	15 34	8/25/61 6/20/62 SWS	Adequate
50. Marshall County									
Camp Crove		100 (Est. 1976)	7,500 1976	Devonian-Silurian Systems (limestone and dolomite)	3	825	21	10/12/65 SWS	Adequate
Henry	2,610		384,000 1976	Sand and gravel	3 4	62 75	500 500		Adequate
Lacon	2,147		275,000 1976	Sand and gravel	1 2 3	49 50 50	400 230 235		Adequate
LaRose	165		10,000 1976	Sand and gravel	1 2	47 47	50 50	1/17/73 SWS 1/17/73	Adequate

Sparland	585	00,000	1976	Sand and gravel	2	30	100		Adequate
					3	34	100		
Toluca	1,319	118,900	1976	Ordovician System (Galena-Platteville Dolomite, St. Peter Sandstone)	2	1,670	160	11/5/51 SWS	Adequate
					3	1,342	230		
Varna	417	80,000	1976	Silurian System (Niagaran dolomite) Ordovician System (Calena-Platteville Dolomite, St. Peter Sandstone)	2	1,870	149	8/6/49	Adequate
Wenoma	1,080	85,000	1976	Silurian System (Niagaran dolomite) Ordovician System (Galena-Platteville limestone, St. Peter Sandstone)	4	62	60		Adequate
					5	1,837	150	3/29/57 SWS	
51. Mason County									
Easton	386	24,000	1978	Sankoty sand	1	135	125	10/5/60 SWS	Adequate
					2	138	125	8/30/71 SWS	
Havana	4,376	810,000	1977	Illinois River Valley alluvium, Sankoty sand	2	84	650		Adequate
					4	75	650		
					5	96	630	9/19/74 SWS	
Manito	1,334	105,000	1976	Sankoty sand	1	81	55	7/15/37 SWS	Adequate
					2	84	80		
					3	100	300	5/11/67 SWS	
Mason City	2,611	380,000	1978	Sankoty sand	3	197.5	240		Adequate
					4	222	140		
					5	208	500		
San Jose	681	60,000	1976	Sankoty sand	4	186	150		Adequate
52. Massac County									
Drockport	1,046	129,000	1974	Ohio River Valley alluvium	East	207	120		Adequate
					West	208	18C		
Joppa	531	50,000	1972	Mississippian System (limestone)	1	448	250	12/9/52 SWS	Adequate
					2	240	100	10/30/62 SWS	
								4/10/63 SWS	

Facility	Population 1970 census	spec. census	Average daily pumpage (gallons) (yr)	Aquifer description	Well no.	Depth (ft)	Discharge (gpm)	Aquifer test	Aquifer assessment
Metropolis	6,940		3,850,000 1976	Mississippian System (St. Louis and Salem Limestones)	1	270	650		Adequate
					2	420	1,300		
					3	286	1,800		
					4	400	510		
					5	400	500	5/16/55 SWS	
Millstone Public Water District	4,000 Est.		216,000 1976	Buried Cache River Valley alluvium	ICRR 1	96	300		Adequate
					ICRR 3	99	300	1/6/76	
					1	116	700	8/14/72	
53. McDonough County									
Bardolph	331		15,000 1976	Ordovician System (Galena-Platteville do- lomite, and limestone)	1	1,150	50	12/29/64 SWS	Adequate
Bushnell	3,703		343,500 1976	Ordovician System (Galena-Platteville Dolomite, St. Peter Sandstone)	1	1,509	500	3/2-3/44 SWS	Adequate
					2	1,355	500	3/24/45 SWS	
					3	1,510	500	2/20/45 SWS 8/23/46	
Colchester	1,747		100,000 1978	Troublesome Creek Bottomland sand and gravel	5	32	100	5/13/75 SWS	Marginal
					6	32	85	5/19/75 SWS	
					7	32	75	5/14/75 SWS	
					8	34	50		
Good Hope	477		34,000 1976	Sand and gravel	1	66	Standby 94	4/10/63	Adequate
					2	78			
Industry	558		46,200 1976	Mississippian System (Keokuk-Burlington dolomite)	1	450	120	5/9/51 SWS	Adequate
Prairie City	630		40,000 1976	Ordovician System (Galena-Platteville Dolomite)	1	1,375	100	5/24/54 SWS	Adequate
54. McLean County									
Anchor	200		11,800 1975	Wisconsinan sand and gravel	1	83	20	1/20/66 SWS	Adequate
Arrowsmith	305		20,000 1975	Sand and gravel	1	228	120	10/6/52 SWS	Adequate
Bellflower	400		43,200 1975	Wisconsinan sand and gravel	1	70	60	2/9-10/51 SWS	Adequate
					2	120	80	9/1/60 SWS	

Carlock	373	38,000	1977	Sand and gravel	1	254	50	8/2-3/61	SWS	Adequate	
					2	245	40	11/7/77	SWS		
Chenoa 1,860	218,000	1976	Deep Wells: Silurian and Ordovician Systems (Niagaran-Alexandrian limestone, Calena-Platocville limestone, St. Peter Sandstone)	1	2,035	65				Marginal	
				2	194	42					
				3	129	22	4/6/66				
				4	1,914	115	2/9/73				
Colfax	935	85,000	1977	Sand and gravel	2	102	150	7/25/45	SWS	Adequate	
					3	105	150	5/20/77	SWS		
Cooksville	241	17,500	1975	Sand and gravel	1	135	60	4/19/62	SWS	Adequate	
					2	133	15	1/4/78			
Danvers	854	74,300	1977	Danvers Bedrock Valley sand and gravel	3	428	90	10/16/39	SWS	Adequate	
					4	438	90	9/30/61	SWS		
Downs	651	42,000	1976	Wisconsinan glacial sand and gravel	1	107	160	10/3-4/52	SWS	Adequate	
					3	134	135	5/3/72	SWS		
Ellsworth	259	14,000	1975	Sand and gravel	1	109	50			Adequate	
					2	109	150	10/14/60			
Gridlev	1,007	183,000	1973	Wisconsinan and Illinoian glacial drifts	3	286	170	7/2/53	SWS	Adequate	
					4	294	170	9/24/63	SWS		
Heyworth	1,441	145,000	1976	Sand and gravel	1	62	240	9/23/35	SWS	Adequate	
								10/12/36	SWS		
					2	59	170	11/2/59	SWS		
Hudson	802	65,000	1976	Sand and gravel	1	160	90	8/4/55	SWS	Adequate. Well #1 is alternated with Well #2.	
					2	96	200	6/13/67	SWS		
LeRoy	2,435	2,631 (1974)	213,000	1978	Sand and gravel	4	78	160	5/15/68	SWS	Adequate
						5	80	45			
						6	102	300	2/3/67	SWS	
						7	76	75	3/1/78	SWS	
Lexington	1,615	150,000	1977	Buried Danvers Bedrock Valley tributary	3	113.5	150	3/28/47	SWS	Adequate	
					4	130	150	8/27/73	SWS		
McLean	820	90,000	1974	Mahomet Bedrock Valley sand and gravel	1	353	75	10/3/34	SWS	Adequate	
					2	335	55				
					3	340	125	9/25/72	SWS		

Facility	Population 1970 census	Population spec. census	Average daily pumpage (gallons) (vr)	Aquifer description	Well no.	Depth (ft)	Discharge (gpm)	Aquifer test	Aquifer assessment
Normal	26,396	31,343 (1972)	1,981,000 1972	Wisconsinan and Illi- noian sand and gravel	3	210	150	5/21/45 SWS	Adequate
					4	217	180	9/13/62 SWS	
								9/15/43 SWS	
								9/13/62 SWS	
					5	35	100	8/1/47 SWS	
								9/14/62 SWS	
					6	85	300	8/30/50 SWS	
								9/13/62 SWS	
					7	92	330	10/8/51 SWS	
								9/13/62 SWS	
					8	38	135	2/5/54 SWS	
								9/13/62 SWS	
			6/33/59 SWS						
			3/29/67 SWS						
			2/22/67 SWS						
			Pre-Illinoian Sankoty	100	345	1,000	11/7-8/74 SWS		
			sand	101	345	1,000	10/1-2/74 SWS		
				102	364	1,000	10/23/74 SWS		
Saybrook	814		75,000 1975	Wisconsinan sand and gravel	1	59	135	5/20/35 SWS	Adequate
					2	155	Standby	4/16/35 SWS	
Stanford	657		60,000 1977	Pre-Illinoian Sankoty sand	1	235	105		Adequate
					3	248	95	7/12/62 SWS	
55. Menard County									
Athens	1,158		81,000 *(Est.)	Sangamon River Valley alluvium	3	57	300		Adequate. *No master meter installed. Based on 70 gallons per day per capita consumption.
					4	57	150	10/2/69 SWS	
Greenview	740		85,000 1975	Sand and gravel	3	159	200	4/12/50 SWS	Adequate
					4	162	200	8/8/68 SWS	
Oakford	272		19,000 *(Est.)	Sand and gravel	1	90	Standby	8/16/56	Adequate. *Based on 70 gallons per day per capita consumption.
					2	110	140		
Petersburg	2,632		400,000 1975	Sangamon River Valley alluvium	1	48	380		Adequate. City also sup- plies water to Old Salem Chautauqua Association.
					3	56	300		
					4	58	400	9/12/63 SWS	
					5	55	350	8/29/66 SWS	
					6	47	280	10/20/76 SWS	
			7	102	500	6/5/78 SWS			

Tallula	643	40,000	1975	Sand and gravel	Ranney	34	120		Marginal. 5.6-9.7 hrs. needed to meet average and maximum daily consumption in 1975. However, 9/26/77 SWS correspondence indicates that village is seeking 100 gpm from Petersburg water supply. SWS report of Investigation 41, published in 1961, rates the long-term yield of Tallula's aquifer at 25,000 gallons per day during years of normal precipitation.
---------	-----	--------	------	-----------------	--------	----	-----	--	--

56. Mercer County

Aledo	3,325	284,000	1976	Ordovician System (Calena-Platteville limestone, St. Peter Sandstone)	2 3	1,172 1,214	550 750	3/28/56	Adequate
Jov	513	39,500	1977	Mississippian System (Kinderhook Series-shale) Devonian System (Cedar Valley formation-limestone) Silurian System (Niagaran dolomite)	1 2	440 420	75 85	2/4-5/48 SWS	Adequate
Reithsburg	836	65,000	1975	Mississippian River Valley alluvium	1 2	81 81.5	100 100	9/22-23/49 9/22-23/49	Adequate
Matherville	699	60,000	1976	Silurian System (Niagaran and Alexandrian dolomite)	1	604	125	5/28/51	Adequate
New Boston	706	116,500	1976	Mississippi River Valley alluvium	1 2	76.5 80	100 100	1/16/76 SWS	Adequate
New Windsor	723	68,000	1976	Devonian System (Cedar Valley-Wapsipinicon dolomite and limestone) Silurian System (Niagaran dolomite)	1 2	546 658	Standby 130	6/8/53	Adequate
North Henderson	246	16,000	1977	Devonian System (Cedar Valley-Wapsipinicon dolomite and limestone) Silurian System (Silurian dolomite)	1	710	85	7/30-31/57	Adequate

Facility	Population 1970 census	Population spec. census	Average daily pumpage (gallons) (vr)	Aquifer description	Well no.	Depth (ft)	Discharge (gpm)	Aquifer test	Aquifer assessment																																																																																																																																																																				
Seaten	251		38,800 1976	Devonian System (lime rock)	1	244	Standby	6/16-17/52	Adequate																																																																																																																																																																				
					2	364	200			Sherrard	808		58,000 1976	Devonian System (Cedar Valley-Wapsipinicon limestone) Silurian System (dolomite)	1	660	60	9/19-20/63	Adequate	2	670	175	Sweiona		150 (Est. 1976)	10,500 1976	Devonian System (Cedar Valley-Wapsipinicon limestone) Silurian System (dolomite)	1	533.5	45		Adequate	Viola	946		80,000 1976	Devonian-Silurian Systems (limestone and shale) Ordovician System (Maquoketa Shale)	1	1,281	175		Adequate	2	651	100	57. Monroe County										Hacker	380	430 (1974)	24,000 1975	Mississippian System (Cypress Sandstone and Aux Vases Sandstone of Chester Series)	1	314	5	3/29/55 SWS	Adequate	2	304	4	8/31/55 SWS	3	305	7		4	305	9		5	300	19		Maeystown	109		*	Sand and gravel	1	58.5	100	8/2/76 SWS	Adequate. *Not yet in operation.	Valmeyer	733		114,500 1975	Mississippi River Valley alluvium	2	57	135	10/19/70 SWS	Adequate	3	83.7	166	58. Montgomery County										Coalton	304		10,000			1973			Adequate. Water obtained from Nokomis Public Water Supply.	Farmersville	495		55,000 1976	Sand and gravel	1	52	45	1/9/73 SWS	Marginal. No record of actual operation of Well #4 as of April 1978.	2	45	32	1/9/73 SWS	3	51	15	4/21/77 SWS	4	70	40	1/13/78 SWS	Fillmore	397		15,000 1977	Illinoian sand and gravel	1	40	16	12/3/62 SWS	Marginal	2	63	10	7/26/77 SWS	Harvel	275		40,000 1977	Sand and grovel	1	38	120	2/26/54 SWS	Adequate	Irving	599	
Sherrard	808		58,000 1976	Devonian System (Cedar Valley-Wapsipinicon limestone) Silurian System (dolomite)	1	660	60	9/19-20/63	Adequate																																																																																																																																																																				
					2	670	175			Sweiona		150 (Est. 1976)	10,500 1976	Devonian System (Cedar Valley-Wapsipinicon limestone) Silurian System (dolomite)	1	533.5	45		Adequate	Viola	946		80,000 1976	Devonian-Silurian Systems (limestone and shale) Ordovician System (Maquoketa Shale)	1	1,281	175		Adequate	2	651	100	57. Monroe County										Hacker	380	430 (1974)	24,000 1975	Mississippian System (Cypress Sandstone and Aux Vases Sandstone of Chester Series)	1	314	5	3/29/55 SWS	Adequate	2	304	4						8/31/55 SWS	3	305	7			4	305	9		5	300	19		Maeystown	109		*	Sand and gravel	1	58.5	100	8/2/76 SWS	Adequate. *Not yet in operation.	Valmeyer	733		114,500 1975	Mississippi River Valley alluvium	2	57	135	10/19/70 SWS	Adequate	3	83.7	166	58. Montgomery County										Coalton	304		10,000			1973			Adequate. Water obtained from Nokomis Public Water Supply.	Farmersville	495		55,000 1976	Sand and gravel	1	52						45	1/9/73 SWS	Marginal. No record of actual operation of Well #4 as of April 1978.	2		45	32	1/9/73 SWS	3	51	15	4/21/77 SWS	4	70	40	1/13/78 SWS	Fillmore	397		15,000 1977	Illinoian sand and gravel	1	40	16	12/3/62 SWS	Marginal	2	63	10	7/26/77 SWS	Harvel	275		40,000 1977	Sand and grovel	1	38	120	2/26/54 SWS	Adequate	Irving	599		25,000 1971
Sweiona		150 (Est. 1976)	10,500 1976	Devonian System (Cedar Valley-Wapsipinicon limestone) Silurian System (dolomite)	1	533.5	45		Adequate																																																																																																																																																																				
Viola	946		80,000 1976	Devonian-Silurian Systems (limestone and shale) Ordovician System (Maquoketa Shale)	1	1,281	175		Adequate																																																																																																																																																																				
					2	651	100			57. Monroe County										Hacker	380	430 (1974)	24,000 1975	Mississippian System (Cypress Sandstone and Aux Vases Sandstone of Chester Series)	1	314	5	3/29/55 SWS	Adequate	2	304	4	8/31/55 SWS	3	305	7		4	305	9		5						300	19		Maeystown		109		*	Sand and gravel	1	58.5	100	8/2/76 SWS	Adequate. *Not yet in operation.	Valmeyer	733		114,500 1975	Mississippi River Valley alluvium	2	57	135	10/19/70 SWS	Adequate	3	83.7	166	58. Montgomery County										Coalton	304		10,000			1973			Adequate. Water obtained from Nokomis Public Water Supply.	Farmersville	495		55,000 1976	Sand and gravel	1	52	45	1/9/73 SWS	Marginal. No record of actual operation of Well #4 as of April 1978.	2	45	32	1/9/73 SWS	3	51	15	4/21/77 SWS	4	70	40	1/13/78 SWS	Fillmore						397		15,000 1977	Illinoian sand and gravel	1	40	16	12/3/62 SWS	Marginal		2	63	10	7/26/77 SWS	Harvel	275		40,000 1977	Sand and grovel	1	38	120	2/26/54 SWS	Adequate	Irving	599		25,000 1971						Adequate. Water is ob- tained from Witt Public Water Supply.																	
57. Monroe County																																																																																																																																																																													
Hacker	380	430 (1974)	24,000 1975	Mississippian System (Cypress Sandstone and Aux Vases Sandstone of Chester Series)	1	314	5	3/29/55 SWS	Adequate																																																																																																																																																																				
					2	304	4	8/31/55 SWS																																																																																																																																																																					
					3	305	7																																																																																																																																																																						
					4	305	9																																																																																																																																																																						
					5	300	19																																																																																																																																																																						
Maeystown	109		*	Sand and gravel	1	58.5	100	8/2/76 SWS	Adequate. *Not yet in operation.																																																																																																																																																																				
Valmeyer	733		114,500 1975	Mississippi River Valley alluvium	2	57	135	10/19/70 SWS	Adequate																																																																																																																																																																				
					3	83.7	166			58. Montgomery County										Coalton	304		10,000			1973			Adequate. Water obtained from Nokomis Public Water Supply.	Farmersville	495		55,000 1976	Sand and gravel	1	52	45	1/9/73 SWS	Marginal. No record of actual operation of Well #4 as of April 1978.	2	45	32	1/9/73 SWS	3	51	15	4/21/77 SWS	4	70	40	1/13/78 SWS	Fillmore	397		15,000 1977	Illinoian sand and gravel	1	40	16	12/3/62 SWS	Marginal	2	63	10	7/26/77 SWS	Harvel	275		40,000 1977	Sand and grovel	1	38	120	2/26/54 SWS	Adequate	Irving	599		25,000 1971						Adequate. Water is ob- tained from Witt Public Water Supply.																																																																																								
58. Montgomery County																																																																																																																																																																													
Coalton	304		10,000			1973			Adequate. Water obtained from Nokomis Public Water Supply.																																																																																																																																																																				
Farmersville	495		55,000 1976	Sand and gravel	1	52	45	1/9/73 SWS	Marginal. No record of actual operation of Well #4 as of April 1978.																																																																																																																																																																				
					2	45	32	1/9/73 SWS																																																																																																																																																																					
					3	51	15	4/21/77 SWS																																																																																																																																																																					
					4	70	40	1/13/78 SWS																																																																																																																																																																					
Fillmore	397		15,000 1977	Illinoian sand and gravel	1	40	16	12/3/62 SWS	Marginal																																																																																																																																																																				
					2	63	10	7/26/77 SWS																																																																																																																																																																					
Harvel	275		40,000 1977	Sand and grovel	1	38	120	2/26/54 SWS	Adequate																																																																																																																																																																				
Irving	599		25,000 1971						Adequate. Water is ob- tained from Witt Public Water Supply.																																																																																																																																																																				

Nokomis	2,532	180,000	1978	Illinoian sand and gravel	1	40	*	is	Adequate. *Combined output of Wells #1,2, and 3 65 gpm.	
					2	40	*			
					3	40	*			
					4	40	60			
					6	41	90			8/22/51 SWS
					7	38.5	35			12/10/70 SWS
					8	40	50			3/23/77 SWS
					Reymond	890	80,000			1977
2	39.5	75	12/11/53 SWS							
3	36	75	12/20/54 SWS							
4	52	60	12/5/77							
Waggoner	257	10,000	1975	Sand and gravel	1	52	40	2/12/65	Adequate	
					2	53.5	15	6/10/68		
Witt	1,040	110,000	1977	Sand and gravel	1	39	70	Adequate		
					2	39	70			
59. Morgan County										
Chapin	552	35,000	1969	*					Adequate. *Water is obtained from the Jacksonville Public Water Supply.	
Jacksonville	20,553	3,500,000	1977	Sand and gravel	Ranney Well	93	2,600 2,450 1>600	9/1-11/55	Adequate. Three pumps. Water is obtained from the Ranney Well and/or Morgan Lake.	
Meredosia	1,178	120,000	1976	Sand and gravel	2	60	55	5/1/50 SWS	Adequate	
								2/5/73 SWS		
					3	84	120			
					4	87.5	130			
South Jacksonville	2,950	3,231 (1974)	271,800	1976	Sand and gravel	1	79.6	325	9/1/67 SWS	Adequate
						2	63	325	12/21/66 SWS	
60. Moultrie County										
Bethany	1,235	94,700	1978	Kaskaskia River Valley alluvium	1	76	90	2/15/54 SWS	Adequate	
					4	74	65	6/22/54		
					5	75	30			
					6	67	108	4/30/63 SWS		
					7	63	125			
Dalton City	427	30,000	1976	Sand and gravel	1	108	4	9/5/56 SWS	Adequate	
					2	78	100	5/8/67 SWS		
Cays	269	14,000	1976	Sand and gravel	1	114.5	3	12/15/60 SWS	Marginal. No longer a Public Water Supply. Gays purchases water from Sullivan.	
					2	111	5	10/19/60 SWS		
					3	110	20	11/16/64 SWS		

Facility	Population 1970 census	Population spec. census	Average daily pumpage (gallons) (yr)	Aquifer description	Well no.	Depth (ft)	Discharge (gpm)	Aquifer test	Aquifer assessment
Lovington	1,303		83,000 1978	Sand and gravel	2	130		150	Adequate
					3	130.	60		
					5	133	100		
					7	108	100		
Sullivan	4,112		500,000 1973	Sand and gravel	1	129	300	10/6/54 SWS	Adequate. City also sup- plies water to Moultrie County Water District.
					2	120	300		
					3	91	300		
61. Ogle County									
Byron	1,749	1,852 (1976)	400,000 1977	Ordovician System (St. Peter Sandstone)	1	2,000	600	9/11-12/69 SWS	Adequate
					2	673	300		
					3	715	1,000		
Creston	595		65,400 1976	Ordovician System (Galena-Platteville limestone, St. Peter Sandstone)	1	585	Standby	12/30/55 SWS	Adequate
					2	732	250		
Forresteron	1,227		145,000 1976	Cambrian-Ordovician Systems (St. Peter Sand- stone, Ironston Sandstone)	1	400	200	11/3/52 SWS	Adequate
Hillcrest	630		63,400 1977	Ordovician System (St. Peter Sandstone)	1	387	225	10/5/64 SWS	Adequate
					2	1,000	400		
Leaf River	633		72,700 1977	Ordovician System (Platteville Dolomite, St. Peter Sandstone)	2	325	250	12/21/45 SWS	Adequate
Mt. Morris	3,173		352,700 1977	Cambrian System (Gales- ville Sandstone, Eau Claire sandstone)	2	1,147	Standby		Adequate
					3	1,807	240		
					4	1,452	430		
Oregon	3,539		445,500 1976	Cambrian System (Eau Claire sandstone) Cam- brian and Pre-Cambrian Systems (Mt. Simon Sandstone)	1	1,690	270		Adequate
					2	1,200	480		
					3	1,200	550		
Polo	2,542		284,000 1977	Cambrian System (Eau Claire sandstone) Cam- brian and Pre-Cambrian Systems (Mt. Simon Sandstone)	2	1,200	260	4/22/48 SWS	Adequate
					3	1,260	500		

Rochelle	8,594	8,050 (1974)	4,000,000	1977	Cambrian System (Eau Claire sandstone)	3	1,484	Standby		Adequate
					brian and Pre-Cambrian Systems (Mt. Simon Sandstone)	4	1,450	1,000		
					Ordovician System (St. Peter Sandstone)	5	502	575	4/28/38	SWS
						6	867	600		
						7	925	Standby	12/23-24/58	SWS
						8	935	1,800	11/17-18/61	SWS
						9	888	1,200	9/2-3/60	SWS
						10	920	1,200	1/24-25/66	SWS
						1	300	Standby		Adequate
						2	460	280		
62. Peoria County										
Brimfield	729		55,000	1977	Ordovician System (Galena-Platteville Dolomite, Glenwood-St. Peter Sandstone)	1	1,257	150		Adequate
Chillicothe	6,052		750,000	1977	Pleistocene Series - (glacial drift, sand and gravel)	1	80	300		Adequate
						2	127	350	11/2/49	
						3	123	350	2/17/56	
						6	111	Standby	4/8/42	SWS
						7	100	250	8/27/51	
Dunlap	656		70,000	1975	Silurian System (dolomite). Ordovician System (Galena-Platteville Dolomite, Glenwood-St. Peter Sandstone)	1	1,690	150	6/29/64	Adequate
Edelstein Waterworks Co-op		115 (Est. 1977)	6,000	1977	Ordovician System (Galena-Platteville Dolomite, Glenwood-St. Peter Sandstone)	1	1,885	50	2/19/64	SWS Adequate
Elmwood	2,014		160,000	1977	Silurian System (Niagaran-Alexandrian dolomite)	1	1,498	250		Adequate
					Ordovician System (Galena-Platteville Dolomite, St. Peter Sandstone)	3	1,572	300	3/15-16/51	
Clasford	1,066		80,000	1978	Mississippian System (Burlington-Keokuk Limestone)	1	1,669	160		Adequate
					Ordovician System (Galena-Platteville limestone, St. Peter Sandstone)	2	1,618	240	10/22/71	SWS

Facility	Population 1970 census	Population spec. census	Average daily pumpage (gallens) (vr)	Year	Aquifer description	Well no.	Depth (ft)	Discharge (gpm)	Aquifer test	Aquifer assessment
Hanna City	1,282		125,000	1977	Mississippian System (Kinderhook shale and dolomite) Ordovician System (Galena- Platteville Dolomite, St. Peter Sandstone)	1	1,848	70	2/27/52 1/23/57 3/13/69 SWS	Adequate
						2	1,864	100	7/12-13/57 3/13/69	
Kingston Mines	380		22,000	1978	Ordovician System (Maqueketa shale and dolomite, Calena- Platteville Dolomite)	1	1,560	100		Adequate
Mapleton	281		15,000	1978	Sand and gravel	1		100		Adequate
Peoria	126,963	172,127 (Est. 1977)	15,500,000	1978	Sankoty sand and gravel	-	Main and Reserve wells: Main 33 6 MGD Reserve 63 5.5 MGD Sankoty wells: 7 91.2 2 MCD 8 89.2 2.3 MGD 9 95 2.5 MGD 10 93.2 2.5 MGD 12 140 2.75 MGD 14 132 2.16 MGD 15 123.5 2.0 MCD Dodge Street wells: 1 118.5 2.5 MCD 2 113.7 2.5 MCD 3 124 2.5 MGD 4/21/48 4 122.2 2.5 MCD Griswold Street wells: 1 166.7 2 MGD 2 162 2 MCD 12/30/53			Adequate. *An additional 8.5 mgd comes from sur- face water source.
Peoria Heights	7,943	8,239 (1975)	3,500,000	1977	Pleistocene Series (Sankoty sand, glacial drift and alluvium)	5	135	650-800		Adequate. Wells #5 and #6 are alternated with wells #7 and #8. 12/8/61 SWS 8/11/72 SWS 8/7/73 SWS
						6	122	500		
						7	129	650		
						8	123	800-1000		
						9	103	650		
					10	131	650			
Pleasant Valley Public Water District		3,200 (Est. 1976)	226,000	1976	Sand and gravel	2	106	235		Adequate
						3	128	325	7/8/69 SWS	
Princevilla	1,455		200,000	1976	Silurian System (Niagaran-Alexandrian dolomite) Ordovician Sys- tem (St. Peter Sandstone)	1	1,600	325		Adequate. *600,000 gallons per day for canning season from June to October .
						2	1,342	375	9/9/38 SWS	
						3	1,680	440	5/6/71 SWS	

Rome Works	Water	270 (Est. 1977)	14,000	1977	Sand and gravel	1 2	85 54	55 90			Adequate
Trivoli Public Water District		350 (Est. 1977)	14,000	1977	Silurian System (dolomite)	1	1,193	70	9/10/70		Adequate
63. Perry County											
Cutler		508	35,000	1974	Pennsylvanian System (sandstone)	2 3	575 595	87 150		4/11/78 SWS	Adequate
Willisville		659	30,000	1972	Pennsylvanian System (sandstone and limestone)	1 2	550 555	110 110	3/20/40 SWS 7/13/54 SWS		Adequate. In 1974 Willisville started receiving water from Kincaid Reeds Creek Conservation District.
64. Piatt County											
Bement		1,638	165,000	1976	Sand and gravel	1 2	139 163	300 300			Adequate
Cerro Gordo		1,368	1,466 (1975)	100,000	1974	Sand and gravel	3 6 7 8	29 25 31 156	Standby 70 70 250	5/11/49 SWS 10/16/68 SWS 7/8/71 SWS 5/22/75 SWS	Adequate
Cisco		358	28,000	1977	Sand and gravel	2 3	113 215	60 75	10/17/53 SWS		Adequate
DeLand		418	30,000	1974	Sand and gravel	1 3 4 5	65 81 79.5 83	30 30 25 30	12/9/35 SWS 4/21/61 SWS		Adequate
Hammond		502	32,000	Jan. 1978	Sand and gravel	1 2	87 87	200 130			Adequate
LaPlace		400 (Est. 1974)	17,000	1974	Sand and gravel	1	55	50	7/9/70 SWS		Adequate
Mansfield		870	80,200	1977	Sand and gravel	2 3	210 215	155 237	10/16/53		Adequate
Montleello		4,130	4,360 (1973)	500,000	1977	Sand and gravel	1 2 4 5	209 212 263 274	Standby Standby 850 800	6/9/58 1/15/73 SWS	Adequate
White Heath		300 (Est. 1974)	13,500	1974	Sand and gravel	1	233	75	8/19-20/69 SWS		Adequate

65. Pike County

Facility	Population 1970 census	spec. census	Average daily pumpage (gallons) (yr)	Aquifer description	Well no.	Depth (ft)	Discharge (gpm)	Aquifer test	Aquifer assessment
Barry	1,444		137,000 1978	Sand and gravel	1	71.5	135	7/2-3/56 SWS	Adequate. Wells #1 and #2 operate alternately. Com- bined output during simulta- neous operation is 200 gpm.
					2	71.5	155	7/18-19/56 SWS	
Baylis	307		5,000 1977	Mississippian System (Keokuk-Burlington Limestone)	1	429	2.5	8/20/57 SWS	Deficient. Currently limit on the water usage by village ordinance.
					2	450	5	12/30/58 SWS	
					3	500	3		
Griggsville	1,245		150,000 1977	Sand and gravel	1	29.7	100	10/24/63	Adequate
					2	30.2	60	10/24/63	
					3	31	35	10/24/63	
					4	34	75	8/10/65 SWS	
					5	84	200	1/3/78 SWS	
					6	70.9	200	12/21/77 SWS	
Hull	585		70,000 1976	Sand and gravel	1	51	100	3/24/36 SWS	Adequate. Wells #1 and #2 are alternated on a monthly basis.
					2	45	146	6/17-18/36 SWS	
Kinderhook	281		27,000 1976	Sand and gravel	1	40	75	3/22/40	Adequate
					2	38.5	75	4/16/58	
Milton	337		18,000 1977	Mississippian System (Burlington Limestone)	1	113	Standby	4/3/65	Adequate
					2	118	Standby	6/5/56	
					4	56	30	11/24/69 SWS	
Nebo	454		75,000 1977	Bay Creak alluvium	1	43	50	2/9/53	Marginal
					2	52	50	9/12/73	
New Canton	486		25,000 1976	Sand and gravel	1	54	90	5/27/52	Adequate
					2	55	Standby		
Pearl	323		50,000 1977	Limestone outcropping	Spring	-	50		Marginal
Perry	451		40,000 1977	Sand and gravel	1	52	70	4/3/56 SWS	Adequate
					2	74	85	5/24/56 SWS	
Pleasant Hill	1,064		110,000 1977	Sand and gravel	1	57	175	6/16-17/36 SWS	Adequate
					2	60	175	11/4/63 SWS	

66. Pulaski County

Karnak	641		49,100 1977	Sand and gravel	1	37	100	6/10/53	Adequate
Mounds	1,718		338,000 1976	Devonian System (Clear Creek Chert)	1	596	300	11/11/63	Adequate
					2	596	300	11/11/63	

Mound City	1,177	135,000	1975	Devonian System (Clear Creek Formation)	1	630	350		Adequate
Olmsted	453	40,000 (Esc. 1971)		Mississippian System (Osage siltstone and Klnderhook sandstone) Devonian System (Clear Creek Chert)	1	1,000	98	8/1-2/40	Adequate
Pulaski	471	17,000	1974	Cretaceous System (sand and gravel)	1A	88	50	12/15/65 SWS	Adequate
Ullin	546	72,300	1973	Cretaceous System (sand and gravel)	1	150	200	7/30/59	Adequate
67. Putnam County									
Granville- Mark	1,611	140,000	1977	Ordovician System (St. Peter Sandstone).	1 2	1,741.5 1,793	92 200	12/14/48 SWS	Adequate
Hennepin Public Water District	650 (Est. 1973)	152,000	1977	Illinois River Valley alluvium	3 4 5	100 107 135	430 430 650	11/28/55 SWS	Adequate
Magnolia	328	33,000	1976	Wisconsinan sand and gravel	1 4	320 138	Standby 100	11/13/73	Adequate
Mcilabb	246	23,700	1976	Wisconsinan sand and gravel	2	250	100		Adequate
Standard	282	20,000	1977	Ordovician System (St. Peter Sandstone)	2	1,802	200		Adequate
68. Randolph County									
Baldwin	467	68,500	1975	Kaskaskia River Valley alluvium	1 2	65 60	75 40	5/6/64 SWS 10/30/70 SWS	Adequate
Percy	967	88,200	1977	Pennsylvanian System (sandstones of Pott3- ville Formation)	1	427	110	1/15/35 SWS 8/11/53 SWS 8/8/55 SWS 10/9/57 SWS	Adequate
Prairie du Rocher PWD	700 (Est. 1974)	45,800	1974	Mississippi River Valley alluvium	1 2	86 72.6	100 105	5/8/40 SWS 5/6/60	Adequate
Red Bud	2,559	310,000	1978	Mississippian System ---x Vases Sandstone.)	2 3 4 5 6 7 8 9 10	283 293 289 281 285 281 306 272 230	30 95 38 50 65 54 85 32 35	9/1/34 SWS 7/12-13/61 9/1/67 SWS 7/16/70 SWS 3/28/73 3/21/75 SWS	Marginal. Mutual interfer- once effects do not permit all wells to operate simultaneously.

Facility	Population 1970 census	spec. census	Average daily pumpage (gallons) (yr)	Aquifer description	Well no.	Depth (ft)	Discharge (gpm)	Aquifer test	Aquifer assessment
Ruma	154	196 (1975)	12,000 1973	Mississippian System (sandstones of Chester Series)	1	315	65	8/20/62 SWS	Adequate
					2	314	30	3/15/09 SWS	
Steeleville	1,957	2,256	190,000 1975	Pennsylvanian System (sandstones of Pottsville Formation)	1	285	85	8/25/48 SWS	Adequate
								7/14/54 SWS	
					3	319	100	12/14/66 SWS	
					4	314	65	4/10/74 SWS	
					5	335	92	12/15/75 SWS	
69. Richland County									
Calhoun	238		8,000 1972	Pennsylvanian System (sandstone)	1	310	12	5/29/62 SWS	Adequate
					2	330	15	8/2/62 SWS	
Claremont	269	325 (Est. 1973)	10,000 1973	Pennsylvanian System" (sandstone).	1	350	15	11/29/54 SWS	Adequate
					2	340	18	9/1/65 SWS	
Noble	719		60,000 1978	Pennsylvanian System (sandstone)	1	247	5		Marginal
					3	238	2		
					4	230	6		
					6	148	5	4/10/64 SWS	
					7	137	6	4/10/64 SWS	
					9	215	10		
					10	257	3	5/12/77 SWS	
Parkersburg	262		6,300 1972	Pennsylvanian System (sandstone)	1	316	30	8/28/56 SWS	Adequate
					2	297	16	10/17/56 SWS	
West Liberty- Dundas Water District		548 (Est. 1975)	18,500 1975	Pennsylvanian System (sandstone)	1	174	10	7/19/68 SWS	Adequate
					2	168	3	1/15/69 SWS	
					3	170.5	6	4/4/69 SWS	
					4	200	3	2/3/77 SWS	
70. Rock Island County									
Andalusia	950	1,094 (1974)	100,000 1976	Devonian System (limestone)	1	150	180	10/19/54	Adequate
					3	170	155		
Carbon Cliff	1,369		65,000 1974	Ordovician System (Galena Dolomite, St. Peter Sandstone)	1	1,105	300	8/9-10/51	Adequate
					2	300	130	10/29/69	
Coal Valley	3,088		323,000 1976	Devonian-Silurian System (limestone)	2	555	300	7/26-27/62 SWS	Deficient
Cordova	589		42,000 1973	Silurian System (Niagara-Kankakee dolomite)	1	340	250		Adequate

Edgington Commenty	30 (1976)	2,000	1976	Devonian System (dolomite and limestone)	1	525	20		Adequate
Milan	4,873 6,036 (1975)	570,000	1976	Ordovician System (Galena-Platteville limestone)	1 2 3	1,157 320 453	80 140 330	6/28/54 1/28/55	Adequate
Port Byron	1,222	101,000	1977	Silurian System (dolomite)	2 3	462 460	170 160	9/26/52	Adequate
Rapids City	656	65,100	1976	Silurian System (Niagaran-Alexandrian limestone)	1 2	533 540	112 250		Adequate
Reynolds	610	65,000	1976	Silurian System (Niagaran limestone)	1	630	150	4/7-8/52	Adequate
Silvis	5,907	563,000	1976	Silurian System (dolomite) Ordovician System (Glenwood- St. Peter Sandstone)	3 4 5	1,680 480 450	600 230 500	5/1/56 5/3/69 6/24-25/70	Adequate
Silvis Heights Subdivision	3,000 (Est. 1973)	120,000	1973	Silurian System (Niagaran-Alexandrian dolomite)	1 2	555 556	180 265	1/13/53 SWS 1/24/58 SWS	Adequate
71. Saline County									
Stonefort	325	8,200	1972	Pennsylvanian System (sandstone)	1	90	40	8/18/58 SWS	Adequate
72. Sangamon County									
Curran-Gardner Township OWD	3,230 (Est. 1977)	320,000	1977	Sand and gravel	1 2	50 55	300 250	12/12/68 SWS 11/22/68 SWS	Adequate
Dawson	427 504 (1974)	80,000	1976	Sangamon River Valley alluvium	1 2	35.5 54	100 100	1/24/67 SWS 1/21/67 SWS	Adequate
Fancy Creek Township PWD				Sangamon River Valley alluvium					Several test holes drilled including aquifer analysis of TH#2 on 12/30/66. As of Feb. 78, no record of any public groundwater supply system installed.
Ill??opolis	1,122	165,000	1977	Illinoian sand and gravel	1	45	30		Adequate. Village is ob- taining public water supply from DeKalb Agricultural Research, Inc. which obtained 7 mgd from 4 drilled drift wells. Local village well #1 is active only for emer- gency cases.

Facility	Population 1370 census	spec. census	Average daily pumpage (gallons) (yr)	Aquifer description	Well no.	Depth (ft)	Discharge (gpm)	Aquifer test	Aquifer assessment
DeKalb Agricultural Research, Inc.		1,200 (Est. 1977)	1,000,000 1977	Sangamon River Valley alluvium	9	56.5	300	1/17/69	Marginal. Furnishes water to: 1) Illiopolis public water supply 2) Agricultural Re- search Inc. 3) Borden Chemical Co.
					10	58	300	3/5/69	
					11	60	200	5/2/72	
					12	59.5	200	5/3/72	
Mechnnicsburg- Buffalo Water Comm.		1,000 (Est. 1977)	120,000 1975	Sand and gravel	1	44.5	150	11/30/56 SWS	Adequate
					2	48	153	9/9/71 SWS	
Pleasant Plains	644		53,400 1977	Sand and gravel	2	60	200	12/12/75 SWS	Adequate
					3	62	200	12/6,28/76 SWS	
Riverton	2,090		275,000 1976	Sand and gravel	1	47	200	11/30/61	Adequate
					2	52	200	12/1/61	
					3	53	250	9/11/72 SWS	
Spauldir.g Height PWD		550 (Est. 1973)	25,000 1973						Adequate. Water is obtained from Riverton.
Sugar Creek PWD		700 (Est. 1973)	35,000 1973						Adequate. Water is obtained from Riverton.
Williamsville	923		100,000 1972	Sangamon River	3	55	70	9/6/55 SWS	Adequate
				Vailey alluvium	4	56	100	5/19/64 SWS	
73. Schuyler County									
Browning	276		*	Illinois River Valley alluvium	1	90	85	5/19/77	Adequate. Well drilled in 19 77. No record of operation.
Rushville	3,300		415,000 1976	Illinois River Valley alluvium	1	60	320		Adequate
					4	61	Standby		
					5	62	350		
74. Scott County									
Bluffs	866		82,000 1976	Illinois River Valley alluvium	2	57	50	10/9/58 SWS	Adequate
					3	59	250		
Manchester	335		20.000 1972						As of 1977, village is obtaining water directly from Roodhouse public water supply, Greene Co,

Winchester	1,788	200,000	1978	Sandy Creek Valley alluvium	7	63	100	1/19/65 5/8/69	Marginal
					8	52	100		
					9	46	85		
					10	48	85		
75. Shelby County									
Cowden	537	68,000	1976	Kaskaskia River Valley alluvium	2	56	115	10/22/54 SWS	Adequate
					3	51	95		
Findlay	809	93,200	1975	Kaskaskia River Valley alluvium	1	154	130	6/26/35 SWS 3/12/71 SWS	Adequate
					2	163	155		
Herrick	537	32,000	1976	Illinoian sand and gravel	1	78	55	5/22/64 SWS	Adequate
Moweaqua	1,687	110,000	1971	Sand and gravel	4	30	25		Adequate. New well field was developed northwest of village in Macon & Christian Counties. New system is expected to be operational in the fall of 1978.
					5	30	35		
					6	30	35		
					7	28	10		
					8	28	15		
					9	28	15		
					10	30	18		
11	30	25							
12	30	25							
Shelbyville	4.887	575,000	1975	Kaskaskia River Valley alluvium	1	60	190	10/24/55 SWS 6/8/55 SWS 7/20/70 SWS 2/20/69 SWS 7/14/70 SWS 7/3/69 SWS	Adequate
					3	57	275		
					4	59	350		
					5	61	350		
					6	63	350		
					7	60.5	250		
					7	60.5	250		
Sigel	337	15,000	1975	Illinoian sand and gravel	1	65	23	1/5/72 SWS 9/22/72 SWS	Adequate
					2	64	25		
Stewardson	729	70,000	1976	Sand and gravel	1	50	90	6/1/55 SWS	Adequate
Strasburg	456	30,000	1972	Sand and gravel	1	37	50	4/27/64 SWS	Adequate
Tower Hill	683	24,200	1975	Sand and gravel	4	48	60	11/26/71 11/26/71	Adequate
					5	48	60		
Windsor	1,126	107,500	1977	Sand and gravel	2	131	24	2/22/49 4/10/72 2/27/74 SWS	Marginal
					5	63	20		
					6	100	27		
					7	64.5	20		
					8	100	27		
76. Stark County									
Bradford	885	113,000	1976	Ordovician System (Galena-Plattville Limestone, Clenwood Sandstone)	1	2,082	85	10/7/36 SWS	Adequate
					2	2,052	190		

Facility	Population 1970 census	spec. census	Average daily pumpage (gallons) (yr)	Aquifer description	Well no.	Depth (ft)	Discharge (gpm)	Aquifer test	Aquifer assessment
LaFayette	268		10,500 1975	Devonian-Silurian Systems (limestone and dolomite)	1	758	85	9/8/59 SWS	Adequate
Toulon	1,207		102,000 1975	Silurian System (Alexandrian limestone) Ordovician System (St. Peter Sandstone)	1 2	1,452 780	175 238	12/7/43 SWS 6/10/57 SWS 9/10/42 SWS	Adequate
Wyoming	1,563		150,000 1976	Ordovician System (Galena-Platteville Dolomite, St. Peter Sandstone)	1 2	1,557 1,400	195 300	4/17/47 SWS	Adequate
77. St. Clair County									
Fayetteville	379		24,100 1977	Kaskaskia River Valley alluvium	1	88	100	5/4/59 SWS	Adequate
Millstadt	2,168	2,332 (1972)	163,800 1975	Mtssissippian System (Aux Vases Sandstone)	1 2 3 4 6 7 8 9 10	300 300 310 317 320 305 338 301 300	23 2 4 10 34 33 15 11 70		Marginal
Mound PWD		1,950 (Est. 1975)	92,000 1975	Sand and gravel	1 2	90 92	100 100	7/29/58	Adequate
Smithton	847	1,147 (1975)	58,100 1975	Mississippian System (Chester Series sandstone)	2 5 6	200 200 202	21 35 35	12/4/50 SWS 6/2/70 SWS 10/26/70 SWS	Adequate
St. Libory	448		35,000 1975	Sand and gravel	1	65	100	10/23/63 SWS	Adequate
78. Stephenson County									
Cedarville	578	724 (1974)	60,000 1977	Ordovician System (St. Pater Sandstone)	1 2	401.5 245	200 300	4/26/49 SWS	Adequate
Dakota	440	53,000	1977	Ordevician System (St. Feter Sandstone)	1 2	516 480	215 340	9/5/57 SWS	Adequate

Davis	525	42,000	1977	Ordovician-Cambrian Systems (Glenwood-St. Peter Sandstone)	1 2	430 284	175 60	2/24/55 SWS	Adequate	
Freeport	27,736	4,800,000	1977	Ordovician System (St. Peter Sandstone)	2 3 4 5 6	415 502 425 137 472	1,700 1,700 1,650 2,900 1,650	1/27/54 6/29/64 SWS	Adequate	
German Valley	206	30,000	1977	Ordovician System (St. Peter Sandstone)	1	560	100	10/18/71 SWS	Adequate	
Lena	1,722	190,000	1977	Ordovician-Cambrian Systems (St. Peter Sandstone, Galesville Sandstone)	1 2	606 998	100 400		Adequate	
Orangeville	538	40,000	1977	Ordovician System (St. Peter Sandstone) - 2	1 2	304 314	220 220		Adequate	
Pearl City	535	85,000	1977	Ordovician System (St. Peter Sandstone)	3 4	625 668	210 210	9/3/69 SWS 7/8/68 SWS	Adequate	
Rock City	251	16,000	1977	Ordovician System (Glenwood-St. Peter Sandstone)	1	432	200	2/19/57 SWS	Adequate	
Winslow	330	43,000	1977	Ordovician System (St. Peter Sandstone)	2	355	500		Adequate	
79. Tazewell County										
Armington	368	25,000	1976	Sankoty sand and gravel	1 2	213 250	75 100	10/14/48 SWS	Adequate	
Creve Coeur	6,440	6,594 (1973)	850,000	1978	Sand and gravel	1 3 4	91 78 81	550 750 1,050	2/17/71 SWS	Adequate
Deer Creek	647	80,000	1976	Sand and gravel	1 3	267 335	75 150	6/17/75 SWS	Adequate	
Delnvan	1,844	180,000	1976	Sand and Gravel	1 2	158 160	265 325		Adequate	
East Peoria	21,265	2,100,000	1975	Sand and gravel	Allison St. W#1 Allison St. W#2 Catherine St. W#1 N. Main St, W#1 S. Main St. W#2 Meadow Ave, W#1 Meadow Ave. W#2	51 46 80 .95 100 113 115	250 250 450 450 350 350 300	2/28/49 8/2/50	Adequate	

Facility	Population 1970 census	spec. census	Average daily pumpage (gallons) (yr)	Aquifer description	Well no.	Depth (ft)	Discharge (gpm)	Aquifer test	Aquifer assessment																																																																																																																																																																																		
Green Valley	617		40,000 1976	Sand and gravel	1	115	65	10/27/48	Adequate																																																																																																																																																																																		
					2	115	Standby			Hopedale	923		80,000 1976	Sand and gravel	2	180	200	8/2/71 SWS	Adequate	4	222	210	5	205	250	Mackinaw	1,293		165,000 1977	Mackinaw River Valley alluvium	1	43	50	11/25-26/41 SWS	Adequate	3	41	160	4	42	140	8/17/71 SWS	Marquette Heights	2,758		261,000 1976	Sand and gravel	3	125	450	2/13/64 SWS 2/24/65 SWS	Adequate	4	95	450	5	94	450	Minier	986		85,000 1976	Sand and gravel	3	193	190		Adequate	4	193	240	Morton	10,811	12,217 (1973)	1,945,000 1976	Sand and gravel	3	253	650	7/7/70 SWS 8/6/70 SWS 9/20/73 SWS 7/21/76 7/27/77 7/7/77	Adequate. * As of July 1977, W#8, W#9, W#10 drilled & pump test done but no record of oper- ation ,	4	264	685	5	280	600	6	280	400	7	280	600	8	279	*	9	278	*	10	275	*	North Pekin	1.886		179,000 1977	Sand and gravel	1	81	200	5/15/51 SWS 8/15/73 SWS	Adequate	2	104	400	North Tazewell Public Water District	10,000 (Est. 1977)		716,000 1977	Sand and gravel	2	283	Standby	6/11/58 1/31/67 SWS 7/1/68 SWS	Adequate	3	284	Standby	4	270	1,200	5	260	1,200	Pekin	31,375	32,315 (1974)	4,600,000 1978	Sand and gravel	1	91	1,460	8/8/69	Adequate	2	92	1,550	3	100	1,550	4	119	800	5	146	1,500	6	139	1,500	7	120	1,550	South Pekin	955		95,000 1977	Sand and gravel	3	90	400	2/26/73 SWS	Adequate	4	112	450	Tremont	1,942		222,000 1977	Sand and gravel	3	133	Standby	3/30/49 SWS 5/25/65 SWS	Adequate	4	154
Hopedale	923		80,000 1976	Sand and gravel	2	180	200	8/2/71 SWS	Adequate																																																																																																																																																																																		
					4	222	210																																																																																																																																																																																				
					5	205	250			Mackinaw	1,293		165,000 1977	Mackinaw River Valley alluvium	1	43	50	11/25-26/41 SWS	Adequate	3	41	160	4	42	140	8/17/71 SWS	Marquette Heights	2,758		261,000 1976	Sand and gravel	3	125	450	2/13/64 SWS 2/24/65 SWS	Adequate	4	95	450	5	94	450	Minier	986		85,000 1976	Sand and gravel	3	193	190		Adequate	4	193	240	Morton	10,811	12,217 (1973)	1,945,000 1976	Sand and gravel	3	253	650	7/7/70 SWS 8/6/70 SWS 9/20/73 SWS 7/21/76 7/27/77 7/7/77	Adequate. * As of July 1977, W#8, W#9, W#10 drilled & pump test done but no record of oper- ation ,	4	264	685	5	280	600						6	280	400			7	280	600	8	279	*	9	278	*	10	275	*	North Pekin	1.886		179,000 1977	Sand and gravel	1	81	200	5/15/51 SWS 8/15/73 SWS	Adequate	2	104	400	North Tazewell Public Water District	10,000 (Est. 1977)		716,000 1977	Sand and gravel	2	283	Standby	6/11/58 1/31/67 SWS 7/1/68 SWS						Adequate	3	284			Standby	4	270	1,200	5	260	1,200	Pekin	31,375						32,315 (1974)	4,600,000 1978	Sand and gravel			1	91	1,460	8/8/69	Adequate	2	92	1,550	3	100	1,550	4	119	800	5	146	1,500	6	139	1,500	7	120	1,550	South Pekin	955		95,000 1977	Sand and gravel	3	90	400						2/26/73 SWS	Adequate	4			112	450
Mackinaw	1,293		165,000 1977	Mackinaw River Valley alluvium	1	43	50	11/25-26/41 SWS	Adequate																																																																																																																																																																																		
					3	41	160																																																																																																																																																																																				
					4	42	140			8/17/71 SWS																																																																																																																																																																																	
Marquette Heights	2,758		261,000 1976	Sand and gravel	3	125	450	2/13/64 SWS 2/24/65 SWS	Adequate																																																																																																																																																																																		
					4	95	450																																																																																																																																																																																				
					5	94	450																																																																																																																																																																																				
Minier	986		85,000 1976	Sand and gravel	3	193	190		Adequate																																																																																																																																																																																		
					4	193	240																																																																																																																																																																																				
Morton	10,811	12,217 (1973)	1,945,000 1976	Sand and gravel	3	253	650	7/7/70 SWS 8/6/70 SWS 9/20/73 SWS 7/21/76 7/27/77 7/7/77	Adequate. * As of July 1977, W#8, W#9, W#10 drilled & pump test done but no record of oper- ation ,																																																																																																																																																																																		
					4	264	685																																																																																																																																																																																				
					5	280	600																																																																																																																																																																																				
					6	280	400																																																																																																																																																																																				
					7	280	600																																																																																																																																																																																				
					8	279	*																																																																																																																																																																																				
					9	278	*																																																																																																																																																																																				
					10	275	*																																																																																																																																																																																				
					North Pekin	1.886				179,000 1977	Sand and gravel	1	81	200	5/15/51 SWS 8/15/73 SWS	Adequate																																																																																																																																																																											
												2	104	400																																																																																																																																																																													
North Tazewell Public Water District	10,000 (Est. 1977)		716,000 1977	Sand and gravel	2	283	Standby	6/11/58 1/31/67 SWS 7/1/68 SWS	Adequate																																																																																																																																																																																		
					3	284	Standby																																																																																																																																																																																				
					4	270	1,200																																																																																																																																																																																				
					5	260	1,200																																																																																																																																																																																				
Pekin	31,375	32,315 (1974)	4,600,000 1978	Sand and gravel	1	91	1,460	8/8/69	Adequate																																																																																																																																																																																		
					2	92	1,550																																																																																																																																																																																				
					3	100	1,550																																																																																																																																																																																				
					4	119	800																																																																																																																																																																																				
					5	146	1,500																																																																																																																																																																																				
					6	139	1,500																																																																																																																																																																																				
					7	120	1,550																																																																																																																																																																																				
South Pekin	955		95,000 1977	Sand and gravel	3	90	400	2/26/73 SWS	Adequate																																																																																																																																																																																		
					4	112	450																																																																																																																																																																																				
Tremont	1,942		222,000 1977	Sand and gravel	3	133	Standby	3/30/49 SWS 5/25/65 SWS	Adequate																																																																																																																																																																																		
					4	154	Standby																																																																																																																																																																																				
					5	162	Standby																																																																																																																																																																																				
					6	212	400																																																																																																																																																																																				

Washington	7,722	9,466 (1973)	700,000	1977	Sand and gravel	6 7	325 306	650 925	3/12/70 SWS 3/12/70 SWS	Adequate
80. Union County										
Anna	4,766		633,000	1974	Mississippian System (Warsaw, Keokuk- Burlington Limestone)	1A 2	1,031 650	250 350	5/21/36 SWS	Adequate. Water is ob- tained from Anna- Jonesboro Water Commis- sion's public water supply.
Anna-Jonesboro Water Commission		9,038 (Est. 1974)	851,300	1971	Mississippi River Valley alluvium	1 2 3 4	81 81 88 83	625 625 600 650	12/22-23/69 1/21-22/70 2/23/77 12/22/76	Adequate. Water Commission supplies water to Anna, Jonesboro, and Shawnee Valley PWD.
Cobden	1,114		46,400	1964	Mississippian System (Cypress Sandstone)	1 2	227 253	160 160	7/2/64 SWS	Adequate
Dongola	825		48,000	1952	Mississippian System (St. Louis Limestone)	1	301	70		Adequate. Water is mainly obtained from lake. Ground- water is for the standby supply.
Jonesboro	1,676		85,000	1962						Adequate. Water is obtained from Anna-Jonesboro Water Commission's Public Water Supply. Well field is lo- cated in Anna.
81. Vermilion County										
Allerton	327		14,000	1978	Sand and gravel	1 2	50.5 50	50 35	11/26/54 SWS	Adequate
Alvin	318		27,000	1977	Sand and gravel	1	103	50	10/28/69 SWS	Adequate
Bismarck Community Water District		600 (Est. 1974)	35,000	1974	Sand and gravel	1	201	100	8/6/69 SWS	Adequate
East Lynn Community Water System		200 (Est. 1974)	7,000	1974	Sand and gravel	1	150	75	9/14/71 SWS	Adequate
Fairnount	785		60,000	1974	Pleistocene Series (glacial drift), Pennsylvanian (sandstone)	2 3	72 48	40 45	6/12/50 SWS 8/17/64 SWS	Adequate
Fithian	562		28,000	1975	Pleistocene Series (Wisconsinan drift) Pennsylvanian (sandstone)	1 2 3	36 32 220	60 30 50	3/1/51 SWS 10/21/63 SWS 11/8/71 SWS	Adequate

Facility	Population 1970 census	spec. census	Average daily pumpage (gallons) (yr)	Aquifer description	Well no.	Depth (ft)	Discharge (gpm)	Aquifer test	Aquifer assessment
Hoopeston	6,461		953,000 1977	Sand and gravel	3	110	625	7/17/63 SWS	Adequate
					4	110	750	7/17/63 SWS	
					5	104	1,425	3/3/65 SWS	
					6	98	1,740	12/12/73 SWS	
InJianola	374		30,600 1978	Swank Creek alluvial deposits	1	21	14	9/16/63 SWS	Marginal.
					2	17.5	7	8/11/52 SWS	
					3	49	40	11/19/76 SWS	
Oakwood	1,367		38,900 1976	Sand and gravel	3	73	27	6/2/77 SWS	Marginal. Additional 76,000 gallons per day obtained from surface supply, Salt Fork of the Vermilion River.
Potomac	909		55,800 1976	Sand and gravel	4	189	80	12/22/64 SWS	Adequate
					5	178	125	9/10/73 SWS	
					Artesian Well			40	
Rankin	727		72,700 *	Sand and gravel	1	270	50		Adequate. *No Master Meter. Consumption based on 100 gallons per day per capita.
					2	282	80		
Ridge Farm	1,015		113,900 1978	Sand and gravel	1	87	125	5/20/35 SWS	Adequate
					2	90	100	4/22/49 SWS	
					3	96	115	3/30/65 SWS	
Rossville	1,420		120,000 1974	Sand and gravel	4	142	340	8/16/73 SWS	Adequate
					5	135	250		
Sidell	645		43,000 1976	Sand and gravel	3	28	30	8/10/66 SWS	Adequate
					5	66	60	12/22/64	
Vermilion Grove Waterworks Corp.		150 (Est. 1978)	7,800 1978						Adequate. Water is obtained from Ridgefarm Public Water Supply.
82. Wabash County									
Allendale	425		21,800 1971	Pennsylvanian System (sandstone)	1	200	6	9/28/49 SWS	Adequate
					2	206	8	10/19/49 SWS	
					3	170	10.4	1/4/49 SWS	
					4	170	8	2/8/50 SWS	
					5	170	13	2/8/50 SWS	
Bellmont	292		12,300 1972	Pennsylvanian System (sandstone)	1	346	12	10/4/54 SWS	Adequate. No records available for well capacities. Discharge rates are based on EPA Report,
					2	335	20		
					3	330	4		
Keensburg	242		11,000 1976	Sand and gravel	1	50	40	4/29/59 SWS	Adequate

83. Warren County

Alexis	945	72,000	1977	Ordovician System (Maquoketa shale and limestone, Galena- Platteville Dolomite, St. Peter Sandstone)	1 2	1,204 1,215	Standby 290	2/4-5/52	Adequate
Kirkwood	817	46,000	1977	Ordovician System (Maquoketa shale and dolomite, Galena Dolomite)	4 5	1,069 215	35 80		Adequate
Little York	297	35,600	1977	Ordovician System (Maquoketa dolomite)	1 3	326 872	Standby 95	7/29/69	Adequate
Monmouth	11,022	2,300,000	1977	Ordovician System (Galen3-Platteville Dolomite, St. Peter. Sandstone, Oneota Dolomite) Cambrian System (Franconia- Galesville Sandstone)	4 5 6 7 8	2,445 2,445 2,465 2,448 2,460	1,000 1,000 1,000 1,000 1,000	12/16-17-54 SWS 11/17-18/65 SWS	Adequate
Roseville	1,111	140,000	1975	Illinoian sand and gravel	9	*	145		Marginal. Horizontal infil- tration well.

84. Washington County

Okawville	992	1,276 (1973)	66,600	1975	Sand and gravel	1 4	70 69	50 70	12/11/70 SWS 1/1/71 SWS	Adequate
-----------	-----	-----------------	--------	------	-----------------	--------	----------	----------	----------------------------	----------

85. Wayne County

Cisne	615	60,400	1977	Pennsylvanian System (sandstone)	i 2 3	225 225 232	35 35 35	7/14/48 SWS 7/11/72 SWS	Adequate
Jeffersonville	294	16,600	1977	Pennsylvanian System (sandstone)	1 2 3	211 208.3 206	16 4 12	5/11/64 SWS 1/14/71 SWS 5/11/64 SWS 1/14/71 SWS 5/11/64 SWS 1/14/71 SWS	Adequate
Mt. Erie	149	10,000	1974	Pennsylvanian System (sandstone)	1 2	207 215	15 20	3/2/66 SWS 1/12/73 SWS	Adequate

86. White County

Carmi	6,033	671,000	1976	Wabash River Valley alluvium'	1 2 3 4	98 94.2 90 99	500 500 500 500	4/7/71 4/9/71	Adequate
-------	-------	---------	------	----------------------------------	------------------	------------------------	--------------------------	------------------	----------

Facility	Population 1970 census	Population spec. census	Average daily pumpage (gallons) (yr)	Aquifer description	Well no.	Depth (ft)	Discharge (gpm)	Aquifer test	Aquifer assessment
Crossville	860		77,000 1977	Sand and gravel	1	64	200	6/14/56	Adequate
					2	50.5	200	6/19/56	
Enfield	764		37,000 1966	Pennsylvanian System (sandstone)	1	343	14	2/8/49 SWS	Adequate
					2	410	11	10/3/49 SWS	
					3	381	30	4/27/70 SWS	
					4	353	20	6/19/70 SWS	
Mill Shoals	292		18,000 1975	Sand and gravel	1	545	20	2/5/64 SWS	Adequate
					2	53	10	5/7/64 SWS	
					3	91	8	1/19/76 SWS	
					4	87.75	40	1/12/76 SWS	
Springerton	228		15,000 1975	Pleistocene Series (sand and gravel)	1	120	14	10/18/66 SWS	Adequate
					.2	110	20	6/17/66 SWS	
87. Whiteside County									
Albany	942		86,500 1976	Sand and gravel	1	75	100	7/9/56 SWS	Adequate
					2	80	120	8/17/70 SWS	
Erie	1,566		130,000 1977	Pleistocene Series (sand and gravel)	1	567	100	4/14/53 SWS	Adequate
				Ordovician System (Galena-Platteville Dolomite)	2	172	400		
Fulton	3,630		343,000 1977	Ordovician System (Calena-Platteville Dolomite) Cambrian System (Eau Claire & Mt. Simon Sandstones)	2	1,260	190		Adequate
					3	1,943	600		
					4	276	400		
Lyndon	673		36,000 1977	Ordovician System (Calena-Platteville Dolomite)	1	243	180	10/7/61 SWS	Adequate
					2	250	150		
Morrison	4,387		971,000 1977	Ordovician System (Galena-Platteville Dolomite) Cambrian System (Galesville Sandstone)	1	1,643	250	8/15/57	Adequate
					2	2,048	550		
					3	1,625	600		
					4	1,769	1,075		
Prophetstown	1,915		180,000 1977	Silurian System (Niagaran & Alex- andrian dolomite)	3	235	350	3/15/44	Adequate
Rock Falls	10,287		955,000 1976	Sand and gravel				2/20/60	Adequate
					Pemberthy Well	19 3	Standby		
					2	136	1,000		
					3	70	1,000		

Sterling	16,113	2,021,000	1974	Pleistocene Series	1	1,430	590	5/24/46 SWS 4/8/47 SWS 1/3/47 SWS 8/30-31/62 SWS	Adequate							
				(sand and gravel)	2	1,655	440									
				Ordovlcian System	3	1,830	475									
				(Galena-Platteville	4	1,630	570									
				Dolomite, St. Peter	6	86	750									
				Sandstone) Cambrian System (Galesvllle Sandstone)												
Tampico	833	80,000	1977	Sand and gravel	1	173	200	1/10/64	Adequate							
					2	5	3 200									
88. Winnebago County																
Durand	972	115,000	1977	Ordovlcian System	2	201	320	3/18/57 SWS 1/10/75 SWS	Adequate							
				(St. Peter Sandstone)	3	585	500									
				Cambrian System (Galesvllle Sandstone)												
Lake Summerset Subdivision	1,050 (Est. 1976)	117,000	1976	Ordovlcian System	1	277	200	5/27/69 7/19-20-77	Adequate							
				(St. Peter Sandstone)	2	190	250									
Loves Park	- 12,390	2,519,000	1976	Pleistocene Series	1	190	2,180		Adequate							
				(Rock River Valley	2	190	2,280									
				alluvium) Ordovlcian	3	863	850									
				System (Glenwood- St. Peter Sandstone)												
Mulford's Wildwood Subdivision	700 (Est. 1976)	51,000	1976	Ordovlcian System	1	531	225	8/27/57 SWS	Adequate							
				(St. Peter Sandstone)												
North Park Public Water District	18,500 (Est. 1976)	1,506,000	1976	Sand and gravel	2	195	1,250	2/2-3/73	Adequate							
					3	238	2,000									
					4	240	3,500									
Pecatonica	1,781	387,000	1977	Ordovlcian System	1	660	425	3/26/54 SWS 1/10/56 SWS	Adequate							
				(St. Peter Sandstone)	2	750	425									
				Cambrian System (Calesville Sandstone)												
Rockford	147,370	151,478 (1974)	37,000,000	1972	Pleistocene Series	1	1,600	1,000	5/5-6/65 SWS 6/5/45 2/2/61	Adequate						
					(sand and gravel)	2	1,600	1,000								
					Ordovlcian System	3	1,600	1,000								
					(St. Peter Sandstone)	4	1,633	1,000								
					Cambrian System	5	1,615	1,000								
					(Mr. Simon Sandstone)	6	1,605	1,000								
					Croup Wells:											
						1	1,530	2,100								
						3	1,127	2,000								
						4	1,219	2,100								
						5	1,312	2,000								
						6	1,372	1,900								
					Unit Wells:											
	1	1,530	2,100													
	3	1,127	2,000													
	4	1,219	2,100													
	5	1,312	2,000													
	6	1,372	1,900													

Facility	Population		Average daily		Aquifer description	Well no.	Depth (ft)	Discharge (gpm)	Aquifer test	Aquifer assessment
	1970 census	spec. census	(gallons)	(yr)						
						7	1,503	1,580		
						7A	200	1,700	7/26/47	
						8	1,502	1,900		
						8A	245	3,500		
						9	1,600	1,300		
						9A	237	2,000		
						10	1,426	2,100		
						11	245	2,400		
						12	245	2,500		
						13	1,457	1,550		
						14	235	4,200		
						15	1,355	1,200		
						16	1,310	1,525		
						17	1,195	2,200	1/13/65	
						18	1,380	2,300	10/17/61	
						-19	176	3,700		
						20	1,200	1,600	6/1/64	
						21	1,205	1,500		
						22	1,200	1,450	1/31/62	
						23	93	3,700	6/22/64	
						24	222	1,890		
						25	1,290	1,850		
						26	1,326	2,550		
						27	1,280	2,350	8/22/69	
						28	233	5,500	10/18/68	
						30	1,325	1,800	7/28/70	
						35	214	1,845	8/5/71	
						38	238	2,400		
						Camp Grant Well:				
						6	153.6	640	10/15-18/63 SWS	
Rockton	2,099		600,000	1977	Pleistocene Series (sand and gravel)	4	429	200		Adequate
					Ordovician System (St. Peter Sandstone)	5	120	750		
					Cambrian System (Gaiesville Sandstone)	6	728	750	1/30/69 SWS	
South Beloit	3,804	3,895 (1974)	668,000	1976	Cambrian System (Eau Claire Sandstone)	3	1,200	1,450		Adequate. Public water supply system is interconnected with Beloit, Wisconsin which has 6 wells.
					Pre-Cambrian System (Fond du Lac Sandstone)					
Winnebago	1,285		143,000	1976	Ordovician System (St. Fer. er Sandstone)	2	610	240	8/4/49 SWS	Adequate
					Cambrian System (Gaiesville Formation)	3	835	600	3/28/68 SWS	

89. Woodford County-

Benson	490	25,100	19 76	Sand and gravel	4	73	27		Adequate	
					5	116	72	9/2/65 SWS		
Caterpillar Trails Public Water District	1,700 (Est. 1976)	184,000	1976	Sand and gravel	1	358	150	11/30/56 SWS	Adequate	
					2	368	210	6/19/67 SWS		
Congerville	266	301 (1973)	25,000	1977	Sand and gravel	1	47	74	7/18/75 SWS	Adequate
El Paso	2,291	310,000	1977	Sand and gravel	1	120	350		Adequate	
					2	120	300			
Eureka	3,026	493,000	1977	Sand and gravel	4	191	Standby		Adequate. At present, main water source is Eureka Lake. Wells have been used to maintain water levels in the lake, and Eureka is trying to convert to groundwater as sole source.	
		*			5	338	600	8/7/75 SWS		
					6	370	800			
Goodfield	329	34,000	1977	Sand and gravel	1	330	50	3/4/78	Adequate	
					2	320	100	12/20/63		
Low Point Water District	245 (Est. 1976)	22,500	1973	Sand and gravel	4	84	22		Adequate	
					5	84	22			
Metamora	2,176	206,000	1975	Sand and gravel	5	215	170		Adequate	
					6	326	300	1/28-29/60 SWS		
					7	418	400	11/21/74 SWS		
Minenk	2,267	148,000	1974	Ordovician System (Glenwood-St. Peter Sandstone)	1	1,850	100		Adequate	
					2	2,005	160			
Roanoke	2,040	185,000	1975	Sand and gravel	1	39	200		Adequate	
					2	42	200			
					3	52	400	9/23/63 SWS		
					4	60.5	100	4/4/74 SWS		
					5	50.5	400	7/1/74 SWS		
Secor	508	62,000	1976	Sand and gravel	2	158	85		Adequate	
					3	156	100			
Washburn	1,173	145,000	1976	Sand and gravel	1	137	400		Adequate	
					2	137	125			

ADDENDUM

In December 1978 the Village of Philo began purchasing water from Northern Illinois Water Corporation, the water company which services the Champaign-Urbana-Savoy area. Hence, its status is now regarded as sufficient. This change of supply occurred after the study had been concluded.